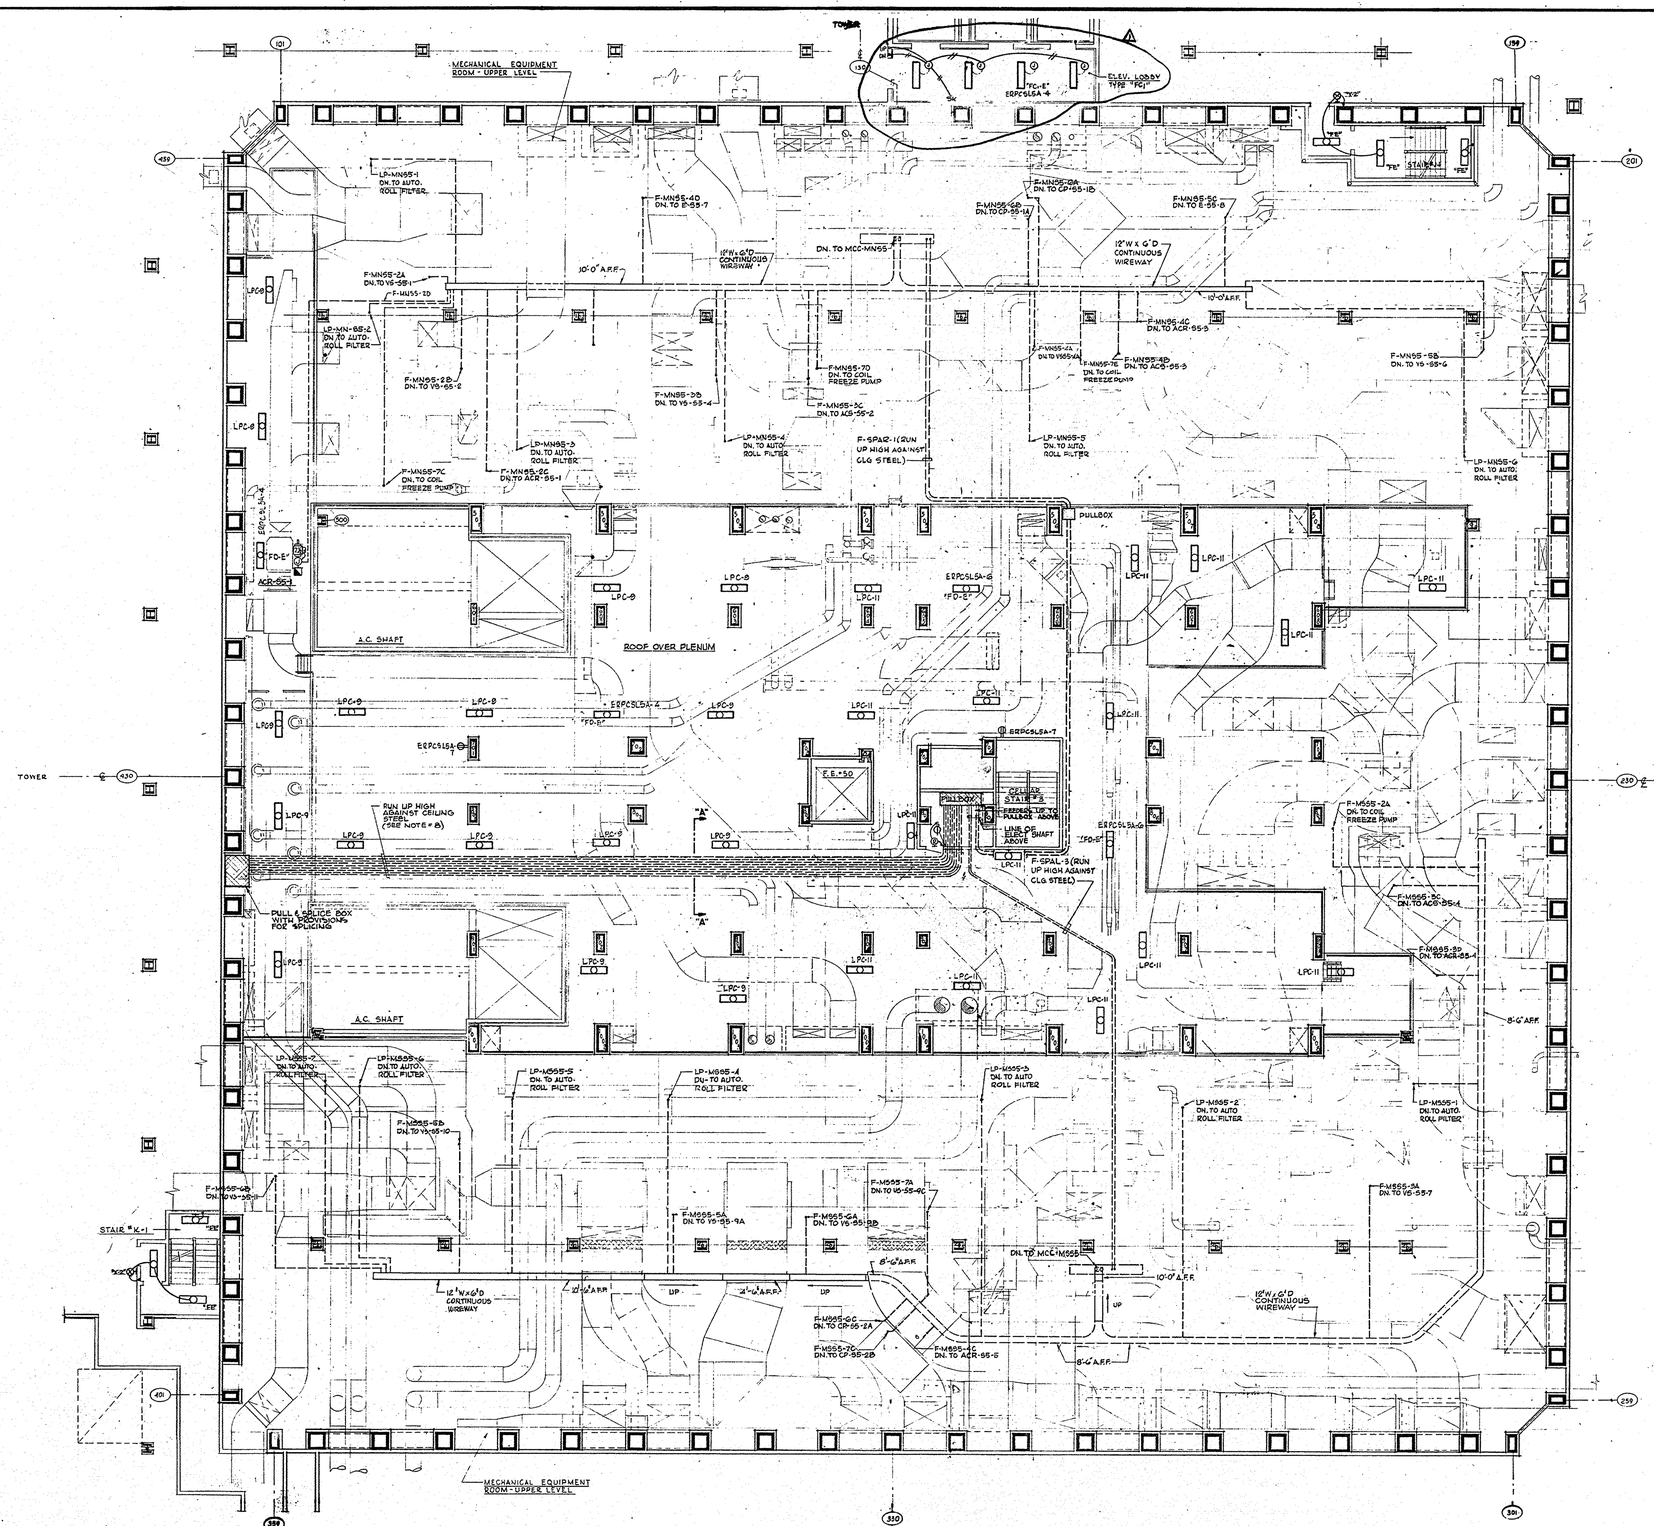


NORTH

NOTES:

1. FOR MAIN LIGHTING LAYOUT IN MECHANICAL EQUIPMENT ROOM SEE SUB-LEVEL NO.5, ELEV. 242' FLOOR PLAN, DWG. # E-A-2.
2. ALL FLUORESCENT CEILING FIXTURES SHALL BE TYPE "FP" PENDANT MOUNTED 10'-0" A.F.F. UNLESS OTHERWISE NOTED.
3. FLUORESCENT FIXTURES OCCURING UNDER MECHANICAL DUCT WORK SHALL BE SUPPORTED FROM STRUCTURAL "I" SHAPES, SUPPORTED OTHER THAN FROM DUCTWORK. PROPER.
4. CONTRACTOR SHALL WIRE ALL FIXTURES IN ACCORDANCE WITH CIRCUIT NUMBERS INDICATED ON DRAWINGS. ALL CONDUIT SHALL BE RUN EXPOSED UNLESS OTHERWISE NOTED.
5. WIREWAYS CONTAINING MORE THAN 30 CURRENT CARRYING CONDUCTORS SHALL BE PROVIDED WITH 4" HIGH BARRIERS.
6. WIREWAY ELEVATIONS A.F.F. ARE APPROXIMATE. THE ELECTRICAL CONTRACTOR SHALL COORDINATE WITH THE OTHER TRADES TO AVOID CONFLICTING INTERFERENCE.
7. ALL FLUORESCENT WALL BRACKET FIXTURES SHALL BE TYPE "FN" MOUNTED 7'-6" ABOVE PLENUM ROOF UNLESS OTHERWISE NOTED.
8. TERMINATE IN PULL & SPLICE BOX WITH PROVISIONS FOR FUTURE SPLICE. FOR EMERGENCY SWITCHBOARD SCHEDULE SEE DWG. E-S-10.

⑥ ④ ④ ③ ③ ③ ② ① ⑦
⑤ ④ ④ ③ ③ ③ ② ① ⑧

SECTION "A-A"

LEGEND

① F-E5B-3	⑤ F-E5B-13
② F-E5B-6	⑥ F-E5B-14
③ F-E5B-10	⑦ 22#12AWG-2"C. - CONTROLS
④ F-E5B-11	⑧ 72#12AWG-3"C. - CONTROLS

1/8" = 1'-0" scale 5 0 5 10 15 20 feet

CONTRACT BID DRAWING date OCT. 16, 1967

NO.	DATE	BUL. NO.	BY
1	12-18-67		

REVISIONS

NO.	DATE	BUL. NO.	BY

REVISIONS

APPROVED

CHIEF, PLANNING DIVISION

DATE

THE WORLD TRADE CENTER

THE PORT OF NEW YORK AUTHORITY

MINORU YAMASAKI & ASSOCIATES
MINORU YAMASAKI, ARCHITECT

EMERY ROTH & SONS
RICHARD ROTH, ARCHITECT

WORTHINGTON, SKILLING, HELLE & JACKSON
STRUCTURAL ENGINEERS

JAROS, BAUM & BOLLES
MECHANICAL ENGINEERS

JOSEPH R. LORING & ASSOCIATES
ELECTRICAL ENGINEERS

THE PORT OF NEW YORK AUTHORITY
PAVING, UTILITIES, FOUNDATIONS

TITLE
LIGHTING AND POWER
SUB-LEVEL NO. 4
ELEV. 253' M.E.R.

DRAWN	R.F.H.	CHECKED	J.R.L.
SCALE	1/8" = 1'-0"	DATE	OCT. 16, 1967
PROJECT NUMBER		SHEET 3	OF 114
DRAWING NUMBER	E-A-3		

FileJuicer