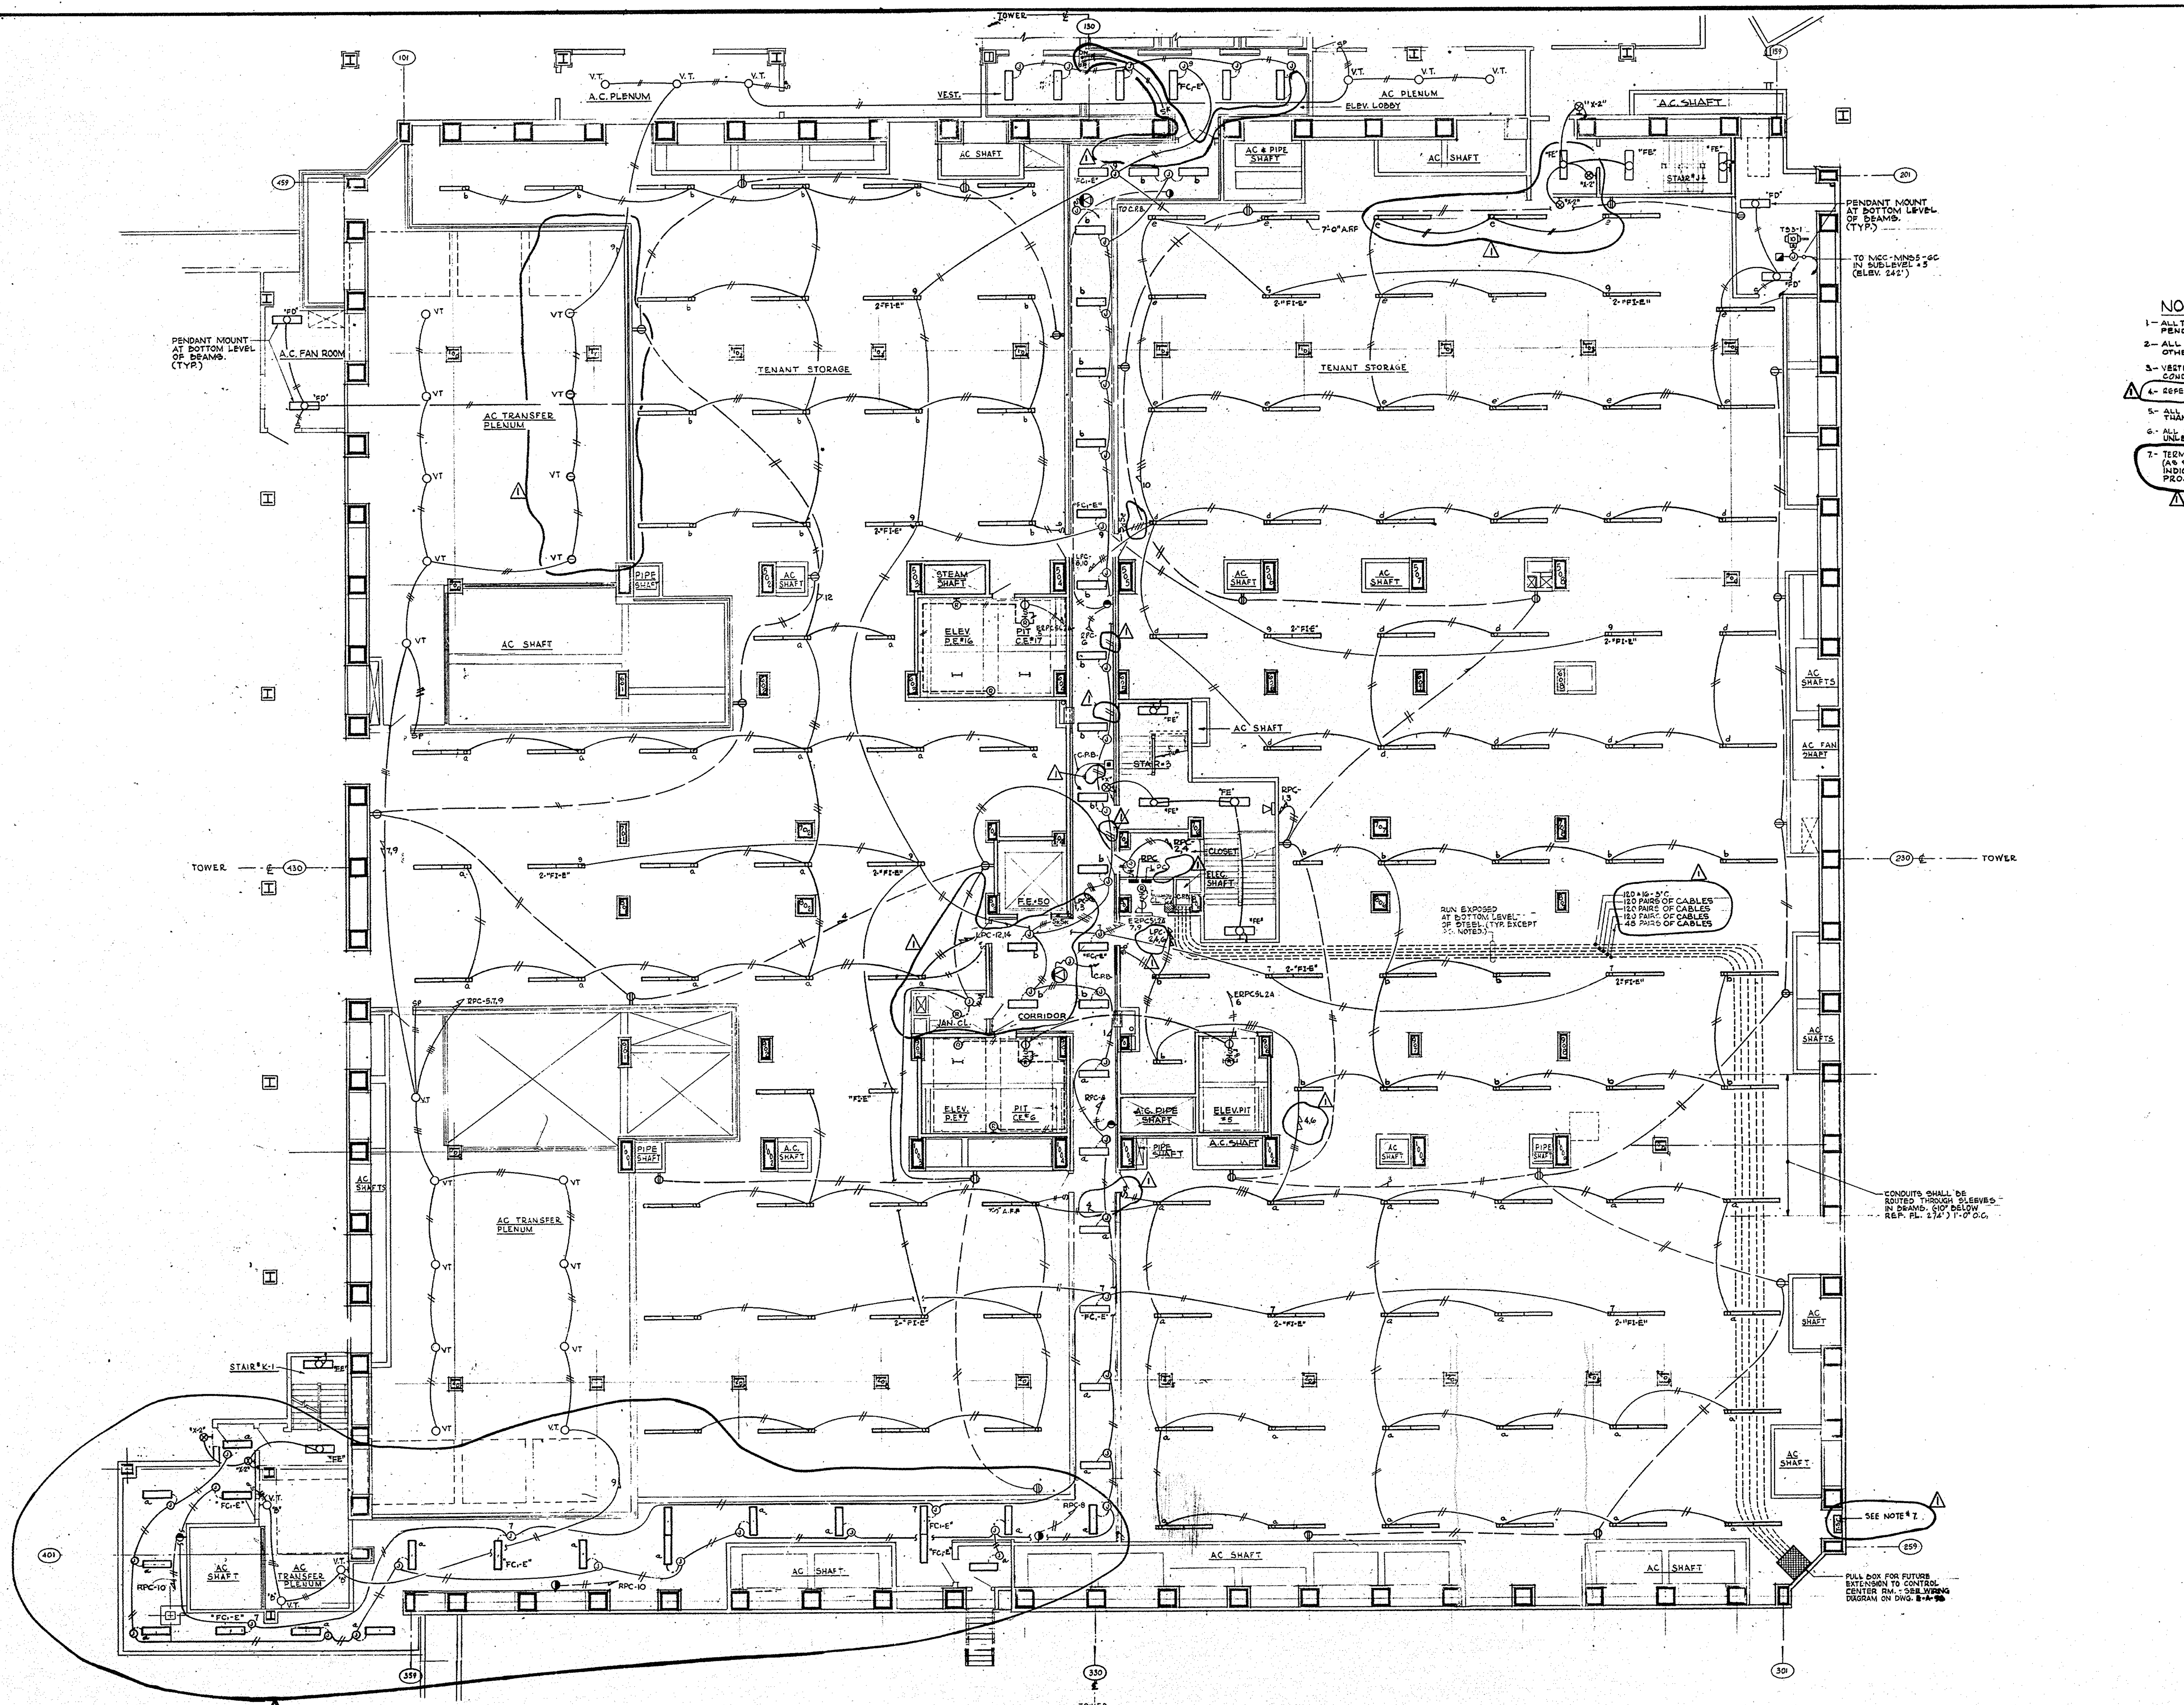


NOTES:

1. ALL TENANT STORAGE FLUORESCENT FIXTURES SHALL BE TYPE "FI" PENDANT MOUNTED 7'-6" A.F.F. UNLESS OTHERWISE NOTED.
2. ALL CORRIDOR FLUORESCENT FIXTURES SHALL BE TYPE "FC1" UNLESS OTHERWISE NOTED.
3. VERTICAL CONDUIT RISERS FOR ELECTRIC CLOSET "C" LIGHTING AND CONDUIT IN ELEVATOR SHAFTS SHALL BE RUN EXPOSED.
4. REFER TO DRAWING E-A-118 FOR TYPICAL LIGHTING PANEL DIAGRAM
5. ALL VERT. COND. & OUTLETS CONCEALED IN WALLS SHALL NOT BE CLOSER THAN 20" FROM FINISH DOOR OPENING.
6. ALL INCANDESCENT FIXTURES IN AC PLENUMS SHALL BE TYPE "BI" UNLESS OTHERWISE NOTED.
7. TERMINATE ALL FIRE PUMP & FIRE STANDPIPE RESERVE TANK ALARM WIRING (AS SHOWN IN DIAGRAM ON DWG. # E-A-107) AT TERMINAL STRIP CABINET INDICATED. EXTENSION OF WIRING TO SPRINKLER CONTROL PANEL IN PROJECT CONTROL CENTER WILL BE DONE UNDER ANOTHER CONTRACT.

CONTRACT BID DRAWING date OCT. 16, 1967

NO.	DATE	BUL. NO.	BY	NO.	DATE	BUL. NO.	BY
1	12-18-67						

REVISIONS — REVISIONS

APPROVED

CHIEF, PLANNING DIVISION

DATE

THE WORLD TRADE CENTER

THE PORT OF NEW YORK AUTHORITY

MINORU YAMASAKI & ASSOCIATES — MINORU YAMASAKI, ARCHITECT

EMERY ROTH & SONS — RICHARD ROTH, ARCHITECT

WORTHINGTON, SKILLING, HELLE & JACKSON — STRUCTURAL ENGINEERS

JAROS, BAUM & BOLLES — MECHANICAL ENGINEERS

JOSEPH R. LORING & ASSOCIATES — ELECTRICAL ENGINEERS

THE PORT OF NEW YORK AUTHORITY — PAVING, UTILITIES, FOUNDATIONS

TITLE: LIGHTING AND POWER - SUB-LEVEL NO. 3 ELEV. 264'

DRAWN	R.F.H.	CHECKED	J.R.L.
SCALE	1/8" = 1'-0"	DATE	OCT. 16, 1967
PROJECT NUMBER		SHEET 4	OF 114
DRAWING NUMBER	E-A-4		

1/8" = 1'0" scale 5 0 5 10 15 20 feet

FileJuicer