
FileJuicer

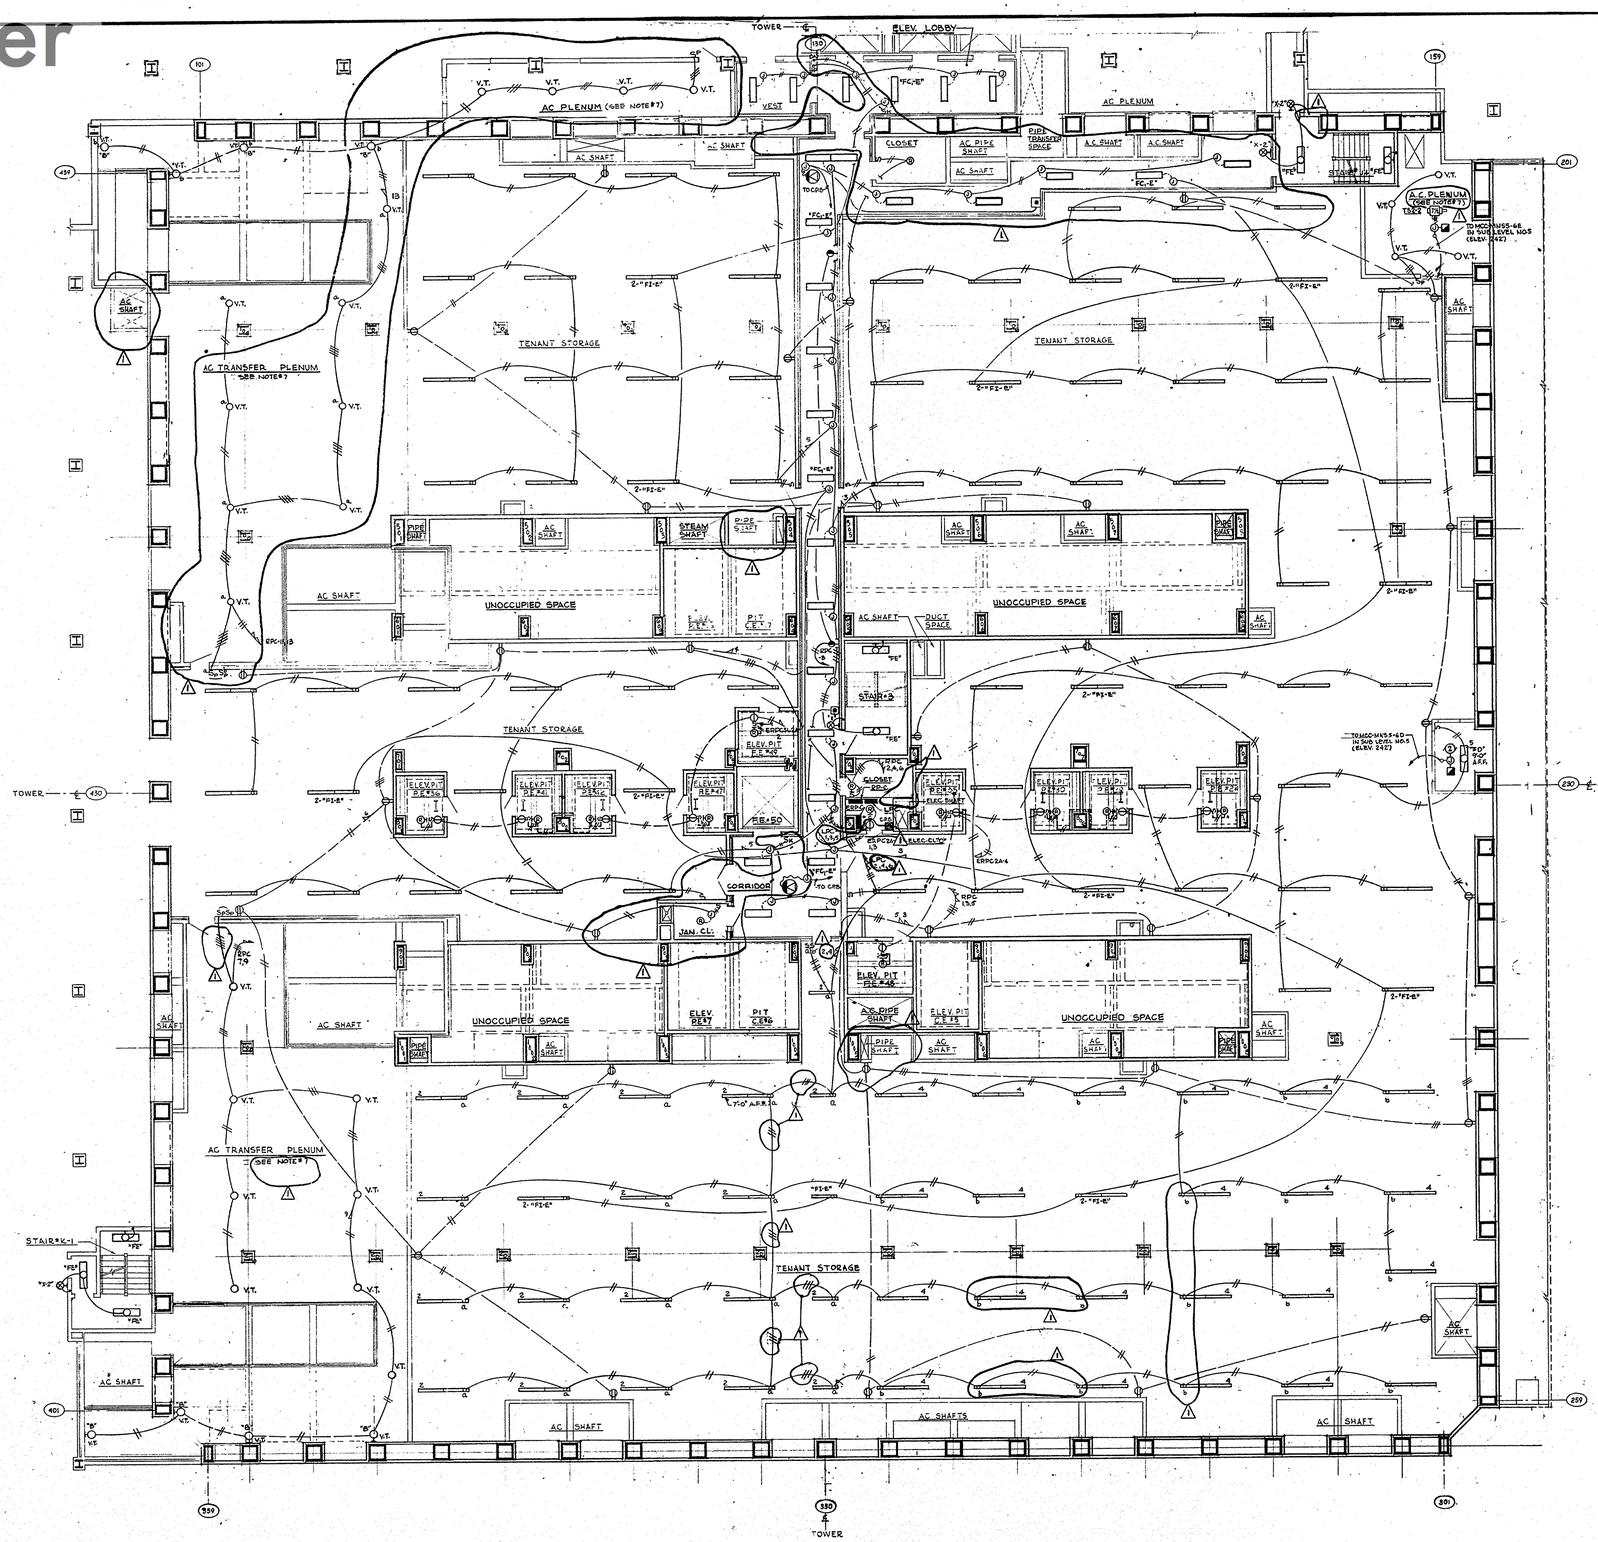

NORTH

NOTES:

1. ALL TENANT STORAGE FLUORESCENT FIXTURES SHALL BE TYPE "F1" PENDANT MOUNTED 7'-0" A.F.F. UNLESS OTHERWISE NOTED.
2. ALL CORRIDOR FLUORESCENT FIXTURES SHALL BE TYPE "FC," UNLESS OTHERWISE NOTED.
3. VERTICAL CONDUIT RISERS FOR ALL ELECTRIC AND TELEPHONE CLOSET LIGHT AND CONDUIT IN ELEVATOR SHAFTS SHALL BE RUN EXPOSED.
4. REFER TO DRAWING E-A-16 FOR TYPICAL LIGHTING PANEL DIAGRAM.
5. ALL VEST CONDUIT OUTLETS CONCEALED IN WALLS SHALL NOT BE CLOSER THAN 20" FROM FINISH DOOR OPENING.
6. ALL INCANDESCENT FIXTURES IN A.C. TRANSFER PLENUMS SHALL BE TYPE "D1" UNLESS OTHERWISE NOTED.
7. CONTRACTOR SHALL COORDINATE THE LOCATION OF ALL LIGHTING FIXTURES TO CLEAR ALL MECHANICAL DUCTWORK.

CONTRACT BID DRAWING date OCT. 14, 1967

NO.	DATE	BUL. NO.	BY
1	11-15-67		

REVISIONS

NO.	DATE	BUL. NO.	BY

REVISIONS

APPROVED

CHIEF, PLANNING DIVISION

DATE

THE WORLD TRADE CENTER

THE PORT OF NEW YORK AUTHORITY

MINORU YAMASAKI & ASSOCIATES
MINORU YAMASAKI, ARCHITECT

WORTHINGTON, SKILLING, HELLE & JACKSON
STRUCTURAL ENGINEERS

JOSEPH R. LORING & ASSOCIATES
ELECTRICAL ENGINEERS

EMERY ROTH & SONS
RICHARD ROTH, ARCHITECT

JAROS, BAUM & BOLLES
MECHANICAL ENGINEERS

THE PORT OF NEW YORK AUTHORITY
PAVING, UTILITIES, FOUNDATIONS

1/8" = 1'0" scale (5 0 5 10 15 20 feet)

TITLE: LIGHTING AND POWER SUB-LEVEL NO.2 ELEV. 274'

DRAWN	R.F.H.	CHECKED	J.R.L.
SCALE	1/8"=1'-0"	DATE	OCT. 14, 1967
PROJECT NUMBER		SHEET 5	OF 114
DRAWING NUMBER	E-A-5		

File Juicer