
FileJuicer

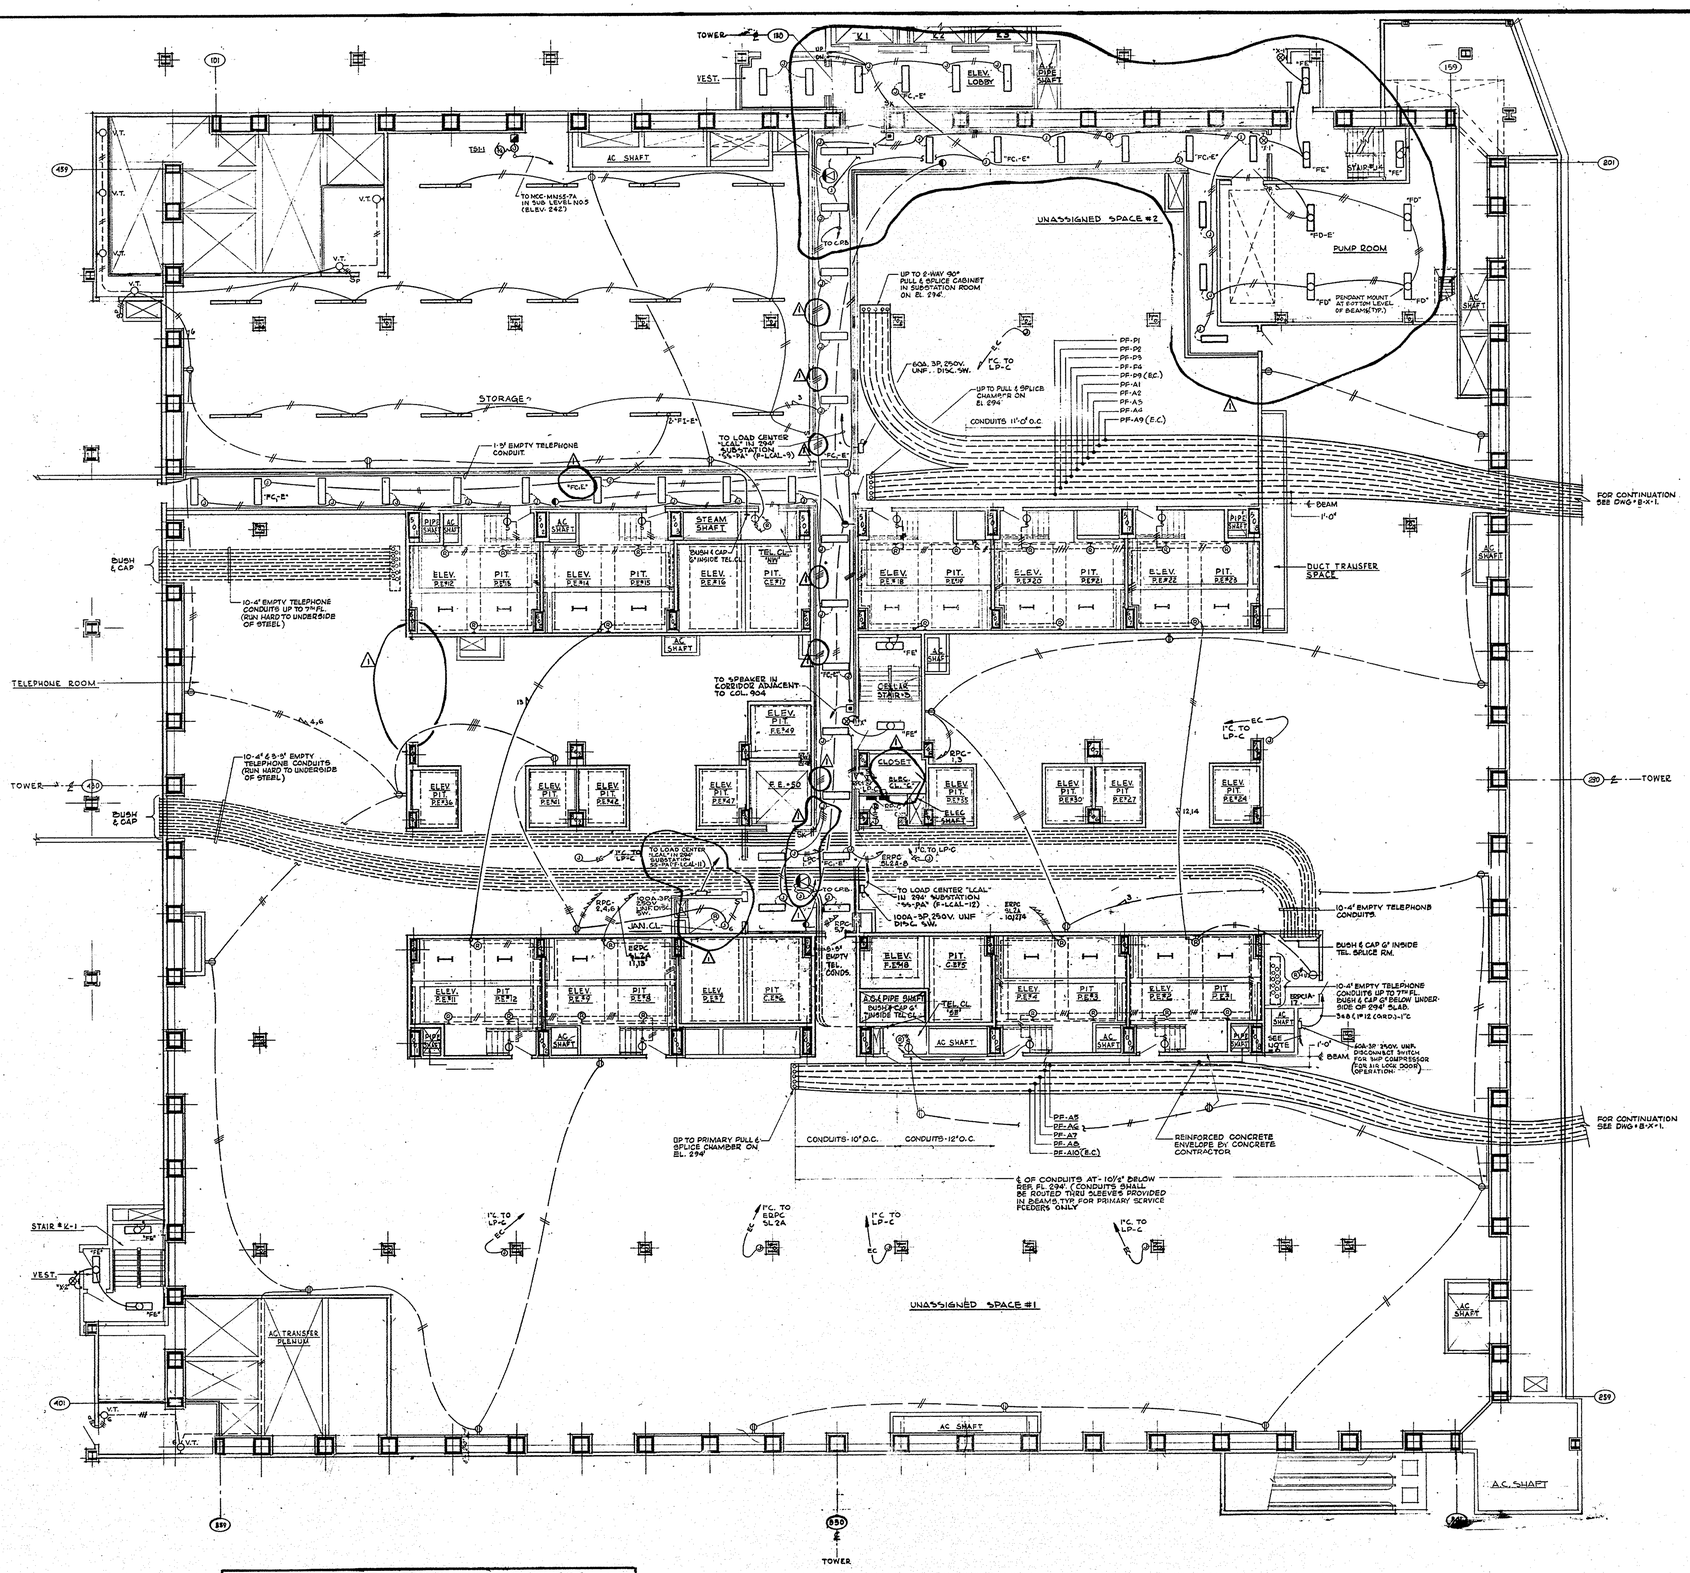

NOTES:

1. ALL TENANT STORAGE FLUORESCENT FIXTURES SHALL BE TYPE "F2" PENDANT MOUNTED 7'-6" A.F.F. UNLESS OTHERWISE NOTED.
2. ALL CORRIDOR FLUORESCENT FIXTURES SHALL BE TYPE "F2" UNLESS OTHERWISE NOTED.
3. VERTICAL CONDUIT RISERS FOR ALL ELECTRIC AND TELEPHONE CLOSET LIGHTS AND CONDUIT IN ELEVATOR SHAFTS SHALL BE RUN EXPOSED.
4. REFER TO DRAWING E-A-118 FOR TYPICAL LIGHTING PANEL DIAGRAM.
5. ALL VERT. COND. & OUTLETS CONCEALED IN WALLS SHALL NOT BE CLOSER THAN 20" FROM FINISH DOOR OPENING.
6. EXTEND AND MAKE ALL REQUIRED CONNECTIONS AND INSTALLATIONS OF AIR LOCK DOOR OPERATING SYSTEM DEVICES AS SPECIFIED.
7. ALL INCANDESCENT FIXTURES IN A.C. PLENUMS SHALL BE TYPE "B" (7'-6" A.F.F.) UNLESS OTHERWISE NOTED.

SCHEDULE OF ELECTRICAL ALLOWANCES

AREA DESIGN	NET RENTABLE AREA. (S.F.)	2'x48" FLUOR. FIXTURE WITH 2 LAMPS (FOR 30 S/C. INITIALS) TYPES "FD" & "FD-E"	SURFACE MOUNTED DUPLEX RECEPTS.	SURFACE MOUNTED TELEPHONE OUTLETS	SURFACE MOUNTED SINGLE POLE SWITCHES
*	22,000	192	69	22	11
**	3,350	29	10	3	3

* UNASSIGNED SPACE #1
** UNASSIGNED SPACE #2

CONTRACT BID DRAWING date OCT. 16, 1967

NO.	DATE	BUL. NO.	BY
1	12-18-67		

REVISIONS

APPROVED

CHIEF, PLANNING DIVISION

DATE

1/8" = 1'-0" scale 5 0 5 10 15 20 feet

THE WORLD TRADE CENTER

THE PORT OF NEW YORK AUTHORITY

MINORU YAMASAKI & ASSOCIATES
MINORU YAMASAKI, ARCHITECT

WORTHINGTON, SKILLING, HELLE & JACKSON
STRUCTURAL ENGINEERS

JOSEPH R. LORING & ASSOCIATES
ELECTRICAL ENGINEERS

EMERY ROTH & SONS
RICHARD ROTH, ARCHITECT

JAROS, BAUM & BOLLES
MECHANICAL ENGINEERS

THE PORT OF NEW YORK AUTHORITY
PAVING, UTILITIES, FOUNDATIONS

TITLE: LIGHTING AND POWER. SUB-LEVEL NO.1 ELEV. 284'

DRAWN	R.F.H.	CHECKED	J.R.L.
SCALE	1/8"=1'-0"	DATE	OCT. 16, 1967
PROJECT NUMBER		SHEET 6	OF 114
DRAWING NUMBER	E-A-6		

File Juicer