
FileJuicer

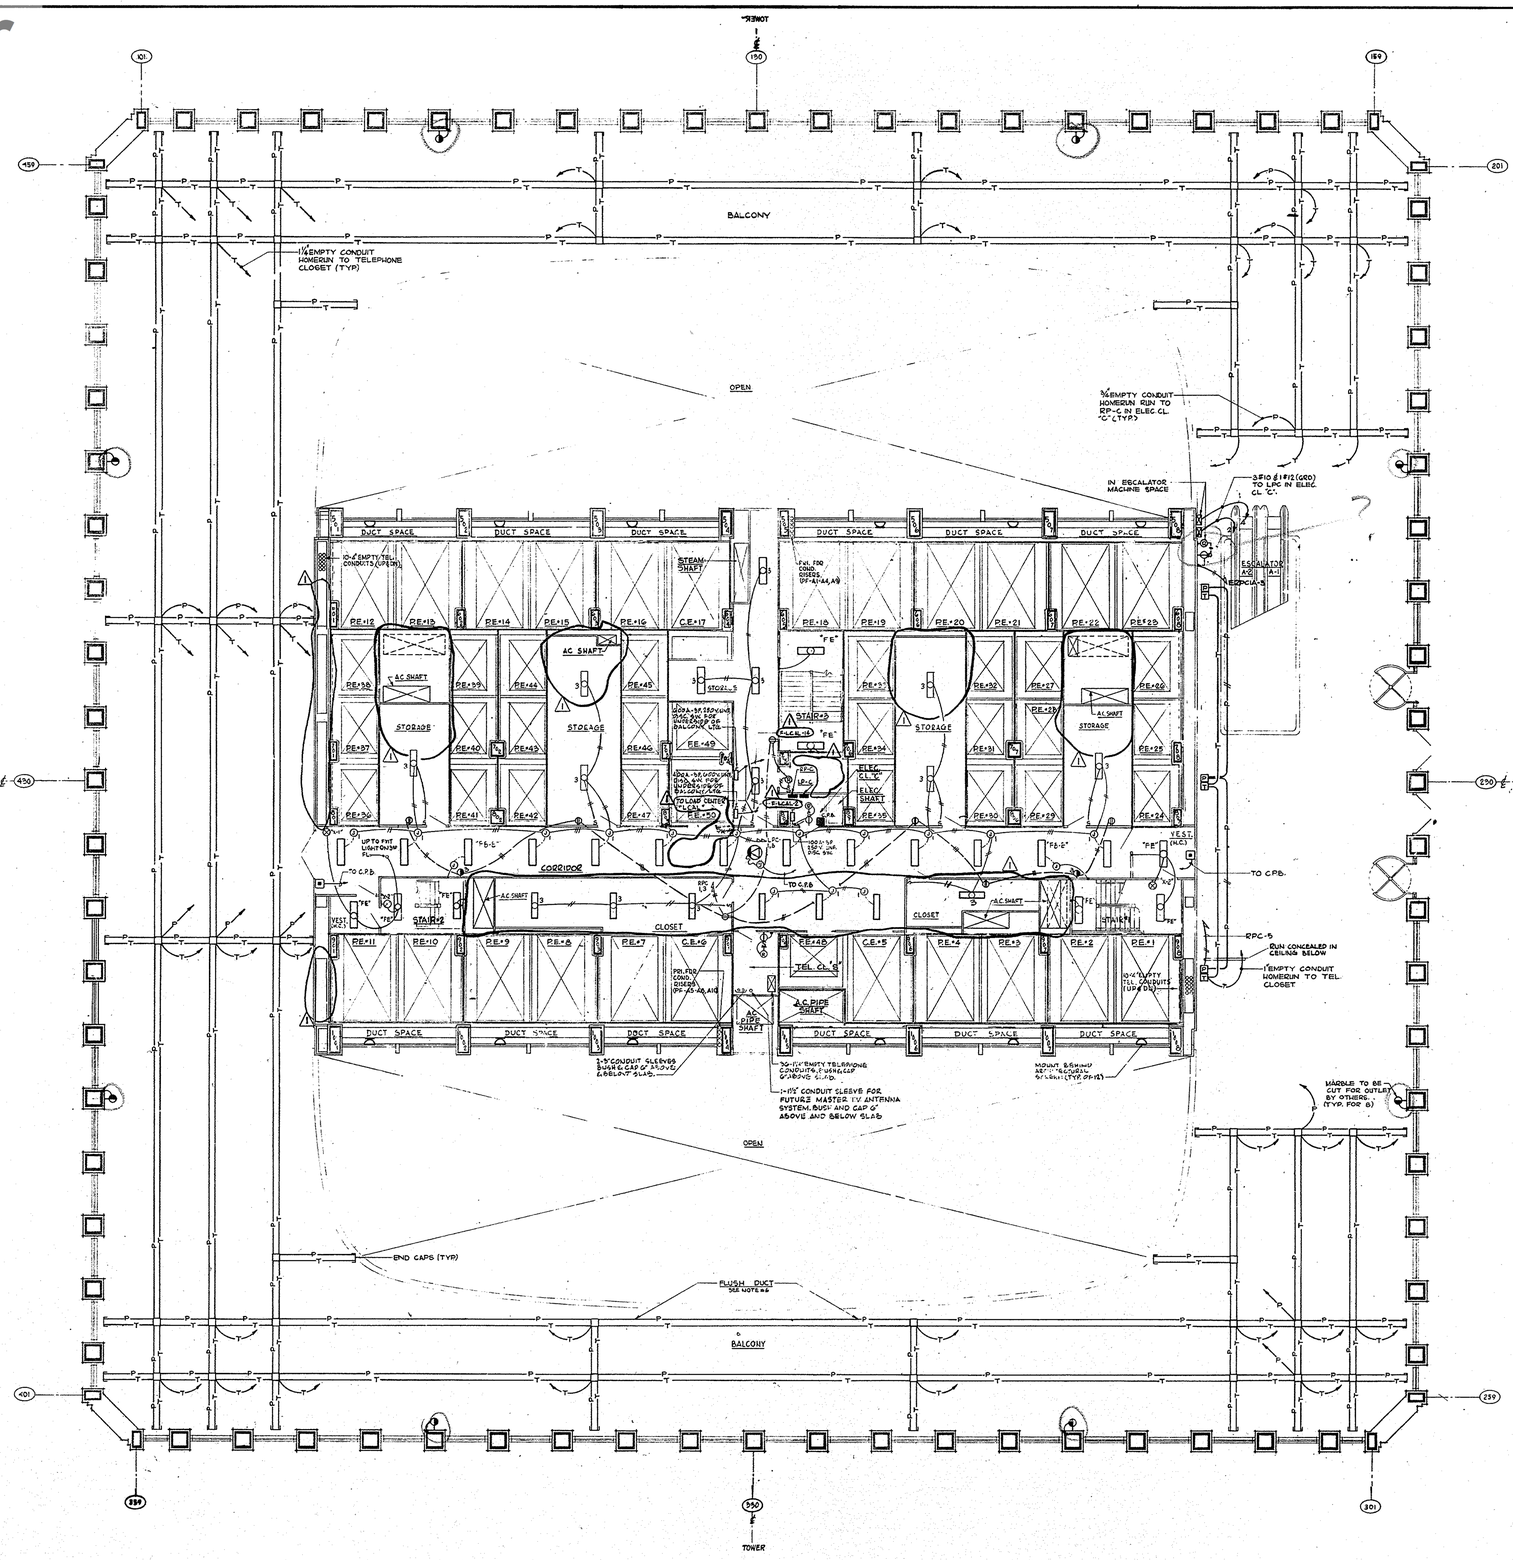

NORTH

NOTES:

1. ALL CORRIDOR LIGHTING FIXTURES SHALL BE TYPE "FB" UNLESS OTHERWISE NOTED.
2. ALL CLOSET AND STORAGE 8'-0" FLUORESCENT LIGHTING FIXTURES SHALL BE TYPE "FE" (40 AFR) UNLESS OTHERWISE NOTED.
3. ALL VERT. COND. & OUTLETS CONCEALED IN WALLS SHALL NOT BE CLOSER THAN 20" FROM FINISH DOOR OPENING.
4. VERTICAL CONDUIT RISERS FOR ELECTRIC CLOSET "C" LIGHTING AND CONDUIT IN ELEVATOR SHAFTS SHALL BE RUN EXPOSED.
5. REFER TO DRAWING E-A-16 FOR ADDITIONAL NOTES.
6. TOP OF FLUSH DUCT SHALL BE ½" BELOW FINISHED FLOOR TOTAL FILL - 3".
7. REFER TO DWG E-A-11B FOR TYPICAL LIGHTING PANEL DIAGRAM.

SCHEDULE OF ELECTRICAL ALLOWANCES

FLOOR NO.	NET RENTABLE AREA (S.F.)	FLUSH DUCT RECEPTACLE FITTINGS	FLUSH DUCT TELEPHONE FITTINGS
2	19,500	150	150

CONTRACT BID DRAWING date OCT. 16, 1967

NO.	DATE	BUL. NO.	BY
1	12-18-67		

REVISIONS

NO.	DATE	BUL. NO.	BY

REVISIONS

APPROVED

CHIEF, PLANNING DIVISION

DATE

THE WORLD TRADE CENTER

THE PORT OF NEW YORK AUTHORITY

MINORU YAMASAKI & ASSOCIATES
MINORU YAMASAKI, ARCHITECT

EMERY ROTH & SONS
RICHARD ROTH, ARCHITECT

WORTHINGTON, SKILLING, HELLE & JACKSON
STRUCTURAL ENGINEERS

JAROS, BAUM & BOLLES
MECHANICAL ENGINEERS

JOSEPH R. LORING & ASSOCIATES
ELECTRICAL ENGINEERS

THE PORT OF NEW YORK AUTHORITY
PAVING, UTILITIES, FOUNDATIONS

1/8" = 1'-0" (5 0 5 10 15 20 scale feet)

TITLE

LIGHTING AND POWER
2ND FLOOR-PLAZA

DRAWN	R.F.H.	CHECKED	J.R.L.
SCALE	1/8"=1'-0"	DATE	OCT. 1967
PROJECT NUMBER		SHEET 9	OF 114
DRAWING NUMBER	E-A-9		