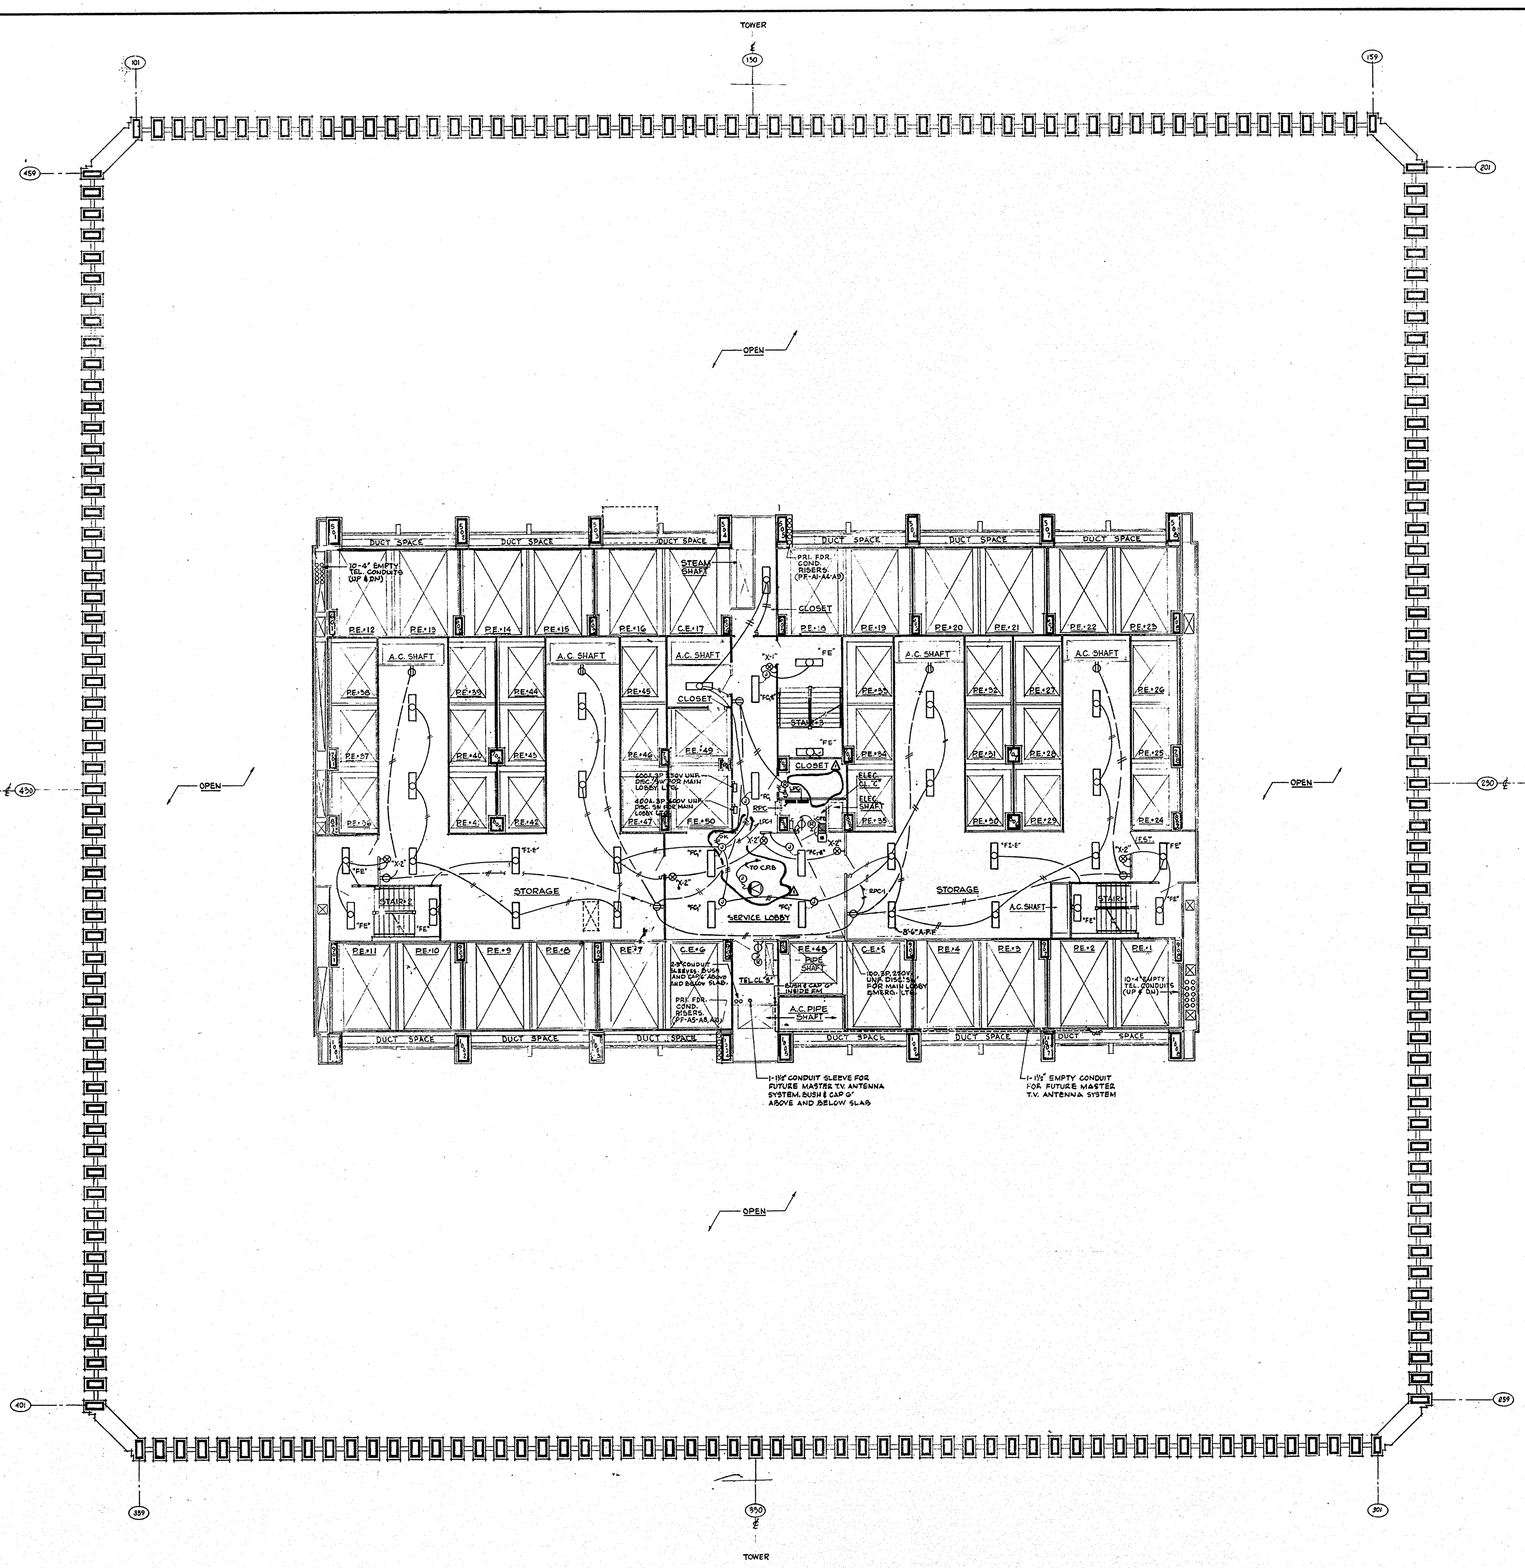


NORTH

NOTES:

1. ALL CLOSET AND STORAGE RM. FLUORESCENT LIGHTING FIXTURES SHALL BE TYPE "EL" (5'-0" A.F.F.) UNLESS OTHERWISE NOTED.
2. ALL VERT. COND. & OUTLETS CONCEALED IN WALLS SHALL NOT BE CLOSER THAN 20" FROM FINISH DOOR OPENING.
3. VERTICAL CONDUIT RISERS FOR ELECTRIC CLOSET "C" LIGHTING SHALL BE RUN EXPOSED.
4. REFER TO DRAWING #E-A-16 FOR ADDITIONAL NOTES.
5. REFER TO DWG "E-A-118 FOR TYPICAL LIGHTING PANEL DIAGRAM

CONTRACT BID DRAWING date OCT. 16, 1967

NO.	DATE	BUL. NO.	BY
1	12-18-67		

REVISIONS

NO.	DATE	BUL. NO.	BY

REVISIONS

APPROVED

CHIEF, PLANNING DIVISION

DATE

THE WORLD TRADE CENTER

THE PORT OF NEW YORK AUTHORITY

MINORU YAMASAKI & ASSOCIATES
MINORU YAMASAKI, ARCHITECT

WORTHINGTON, SKILLING, HELLE & JACKSON
STRUCTURAL ENGINEERS

JOSEPH R. LORING & ASSOCIATES
ELECTRICAL ENGINEERS

EMERY ROTH & SONS
RICHARD ROTH, ARCHITECT

JAROS, BAUM & BOLLES
MECHANICAL ENGINEERS

THE PORT OF NEW YORK AUTHORITY
PAVING, UTILITIES, FOUNDATIONS

1/8" = 1'-0" scale (5 0 5 10 15 20 feet)

TITLE: LIGHTING AND POWER. 6TH FLOOR

DRAWN	E.F.H.	CHECKED	J.R.L.
SCALE	1/8" = 1'-0"	DATE	OCT. 16, 1967
PROJECT NUMBER		SHEET 11	OF 114
DRAWING NUMBER	E-A-11		

FileJuicer