
FileJuicer

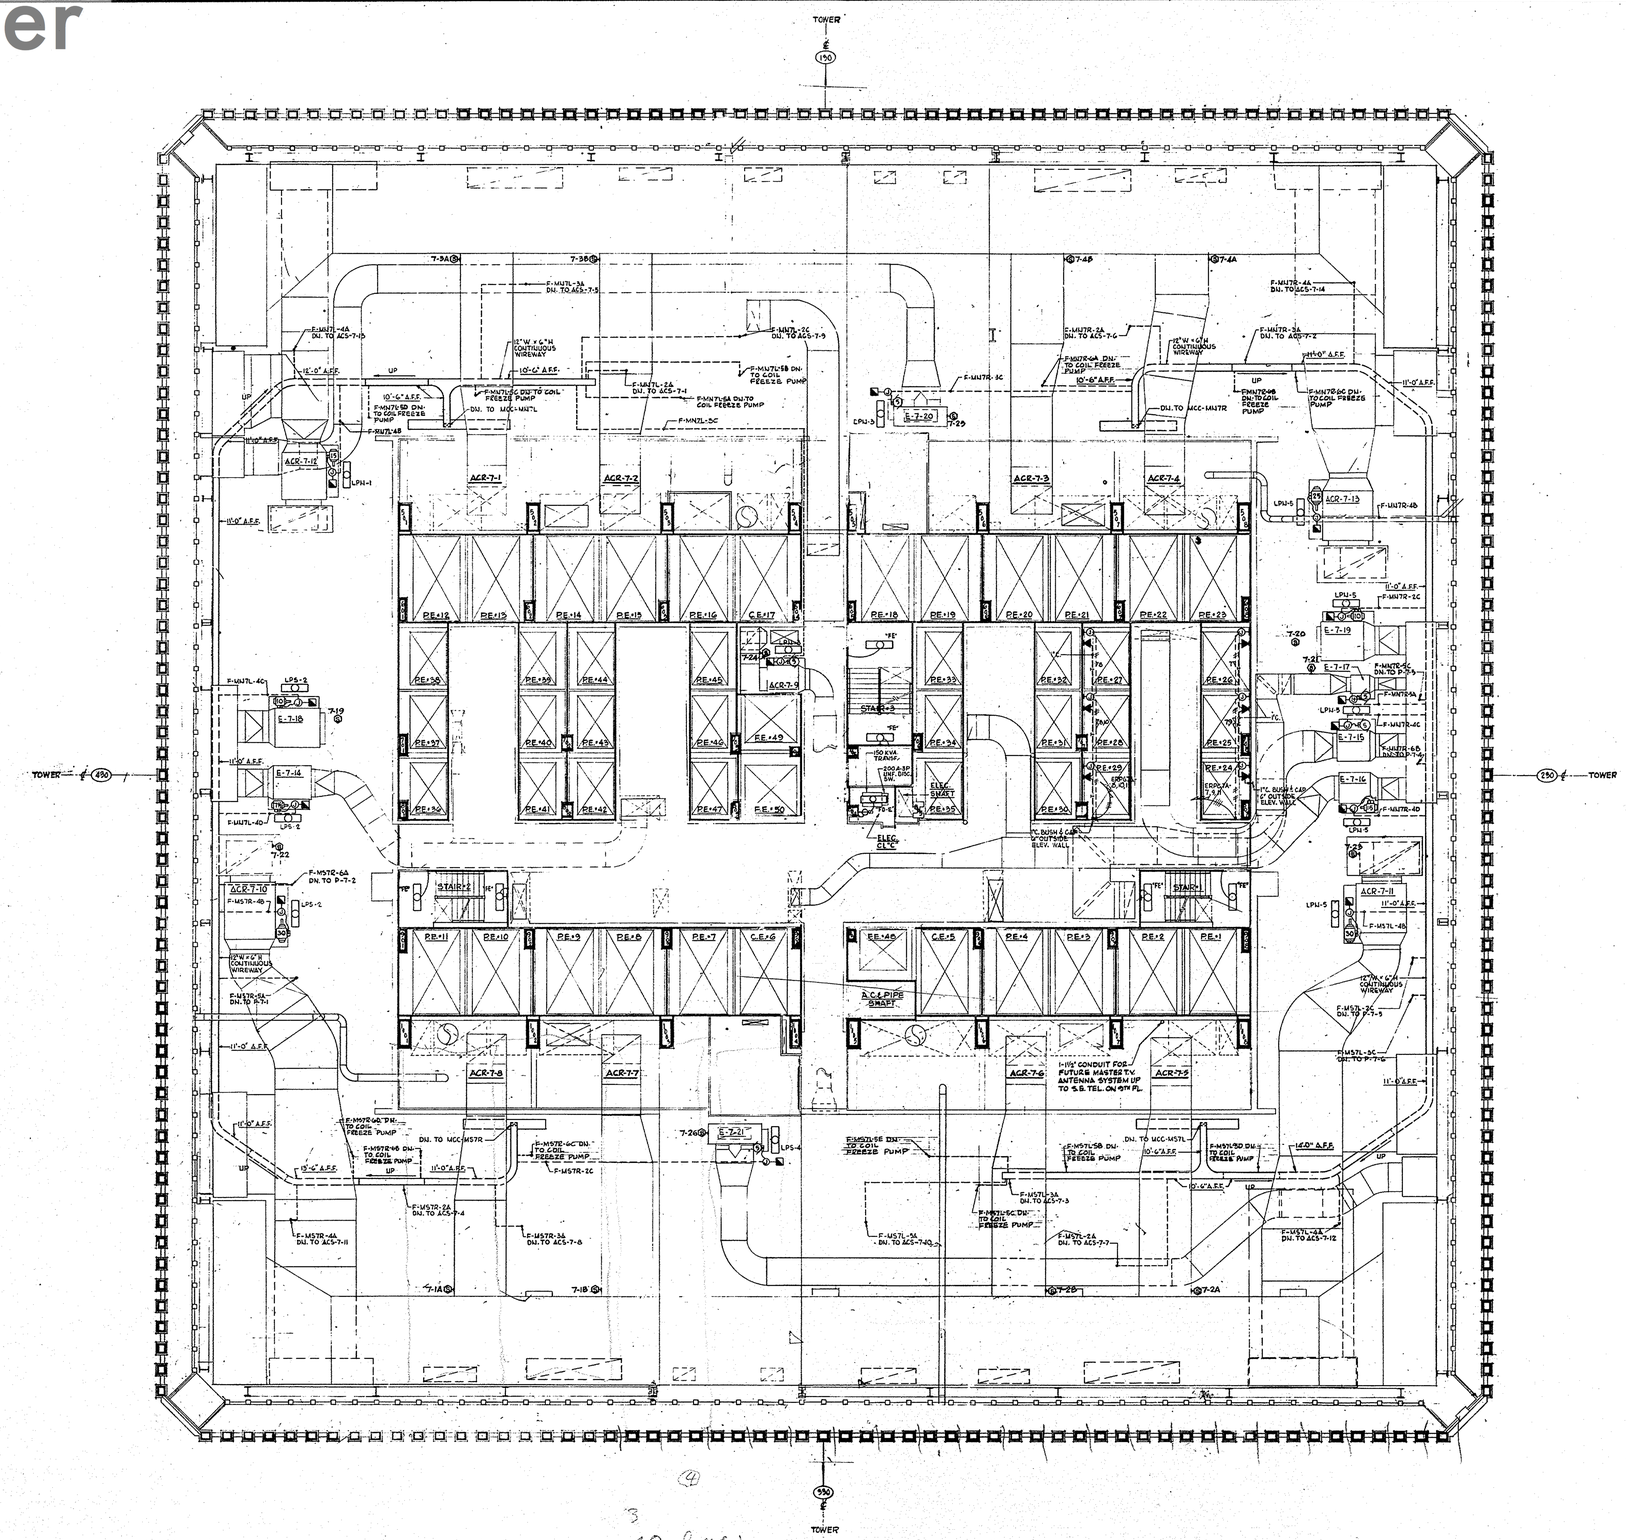

North

NOTES:

1. FOR MAIN LIGHTING LAYOUT IN MECHANICAL EQUIPMENT ROOM SEE 7TH FLOOR PLAN, DWG.# E-A-12.
2. ALL FLUORESCENT CEILING FIXTURES SHALL BE TYPE "FD" PENDANT MOUNTED 10'-0" A.F.F. UNLESS OTHERWISE NOTED.
3. FLUORESCENT FIXTURES OCCURRING UNDER MECHANICAL DUCTWORK SHALL BE SUPPORTED FROM STRUCTURAL "U" CHANNELS, SUPPORTED OTHER THAN FROM DUCTWORK PROFILES.
4. CONTRACTOR SHALL WIRE ALL FIXTURES IN ACCORDANCE WITH CIRCUIT NUMBERS INDICATED ON DRAWINGS. ALL CONDUIT SHALL BE RUN EXPOSED UNLESS OTHERWISE SHOWN.
5. WIREWAYS CONTAINING MORE THAN 30 CURRENT CARRYING CONDUCTORS SHALL BE PROVIDED WITH 6" HIGH BARRIERS.
6. WIREWAY ELEVATIONS A.F.F. ARE APPROXIMATE; THE ELECTRICAL CONTRACTOR SHALL COORDINATE WITH THE OTHER TRADES TO AVOID SPECIFIC INTERFERENCES.
7. ALL VERT. COND. & OUTLETS CONCEALED IN WALLS SHALL NOT BE CLOSER THAN 20" FROM FINISH DOOR OPENING.

3
60 lamps
186
20 lamps

1/8"=1'0" scale 5 0 5 10 15 20 feet

DRAWING Nº E-A-14 AND E-A-15 NOT PART OF THIS CONTRACT.

CONTRACT BID DRAWING date OCT. 15, 1967

NO.	DATE	SUL. NO.	BY

REVISIONS

NO.	DATE	SUL. NO.	BY

REVISIONS

APPROVED

CHIEF, PLANNING DIVISION

DATE

THE WORLD TRADE CENTER

THE PORT OF NEW YORK AUTHORITY

MINORU YAMASAKI & ASSOCIATES
MINORU YAMASAKI, ARCHITECT

EMERY ROTH & SONS
RICHARD ROTH, ARCHITECT

WORTHINGTON, SKILLING, HELLE & JACKSON
STRUCTURAL ENGINEERS

JAROS, BAUM & BOLLES
MECHANICAL ENGINEERS

JOSEPH R. LORING & ASSOCIATES
ELECTRICAL ENGINEERS

THE PORT OF NEW YORK AUTHORITY
PAVING, UTILITIES, FOUNDATIONS

TITLE: LIGHTING AND POWER 8TH FLOOR-M.E.R.

DRAWN	R.F.H.	CHECKED	J.R.L.
SCALE	1/8"=1'-0"	DATE	OCT. 16, 1967
PROJECT NUMBER		SHEET 13	OF 114
DRAWING NUMBER	E-A-13		