

FileJuicer

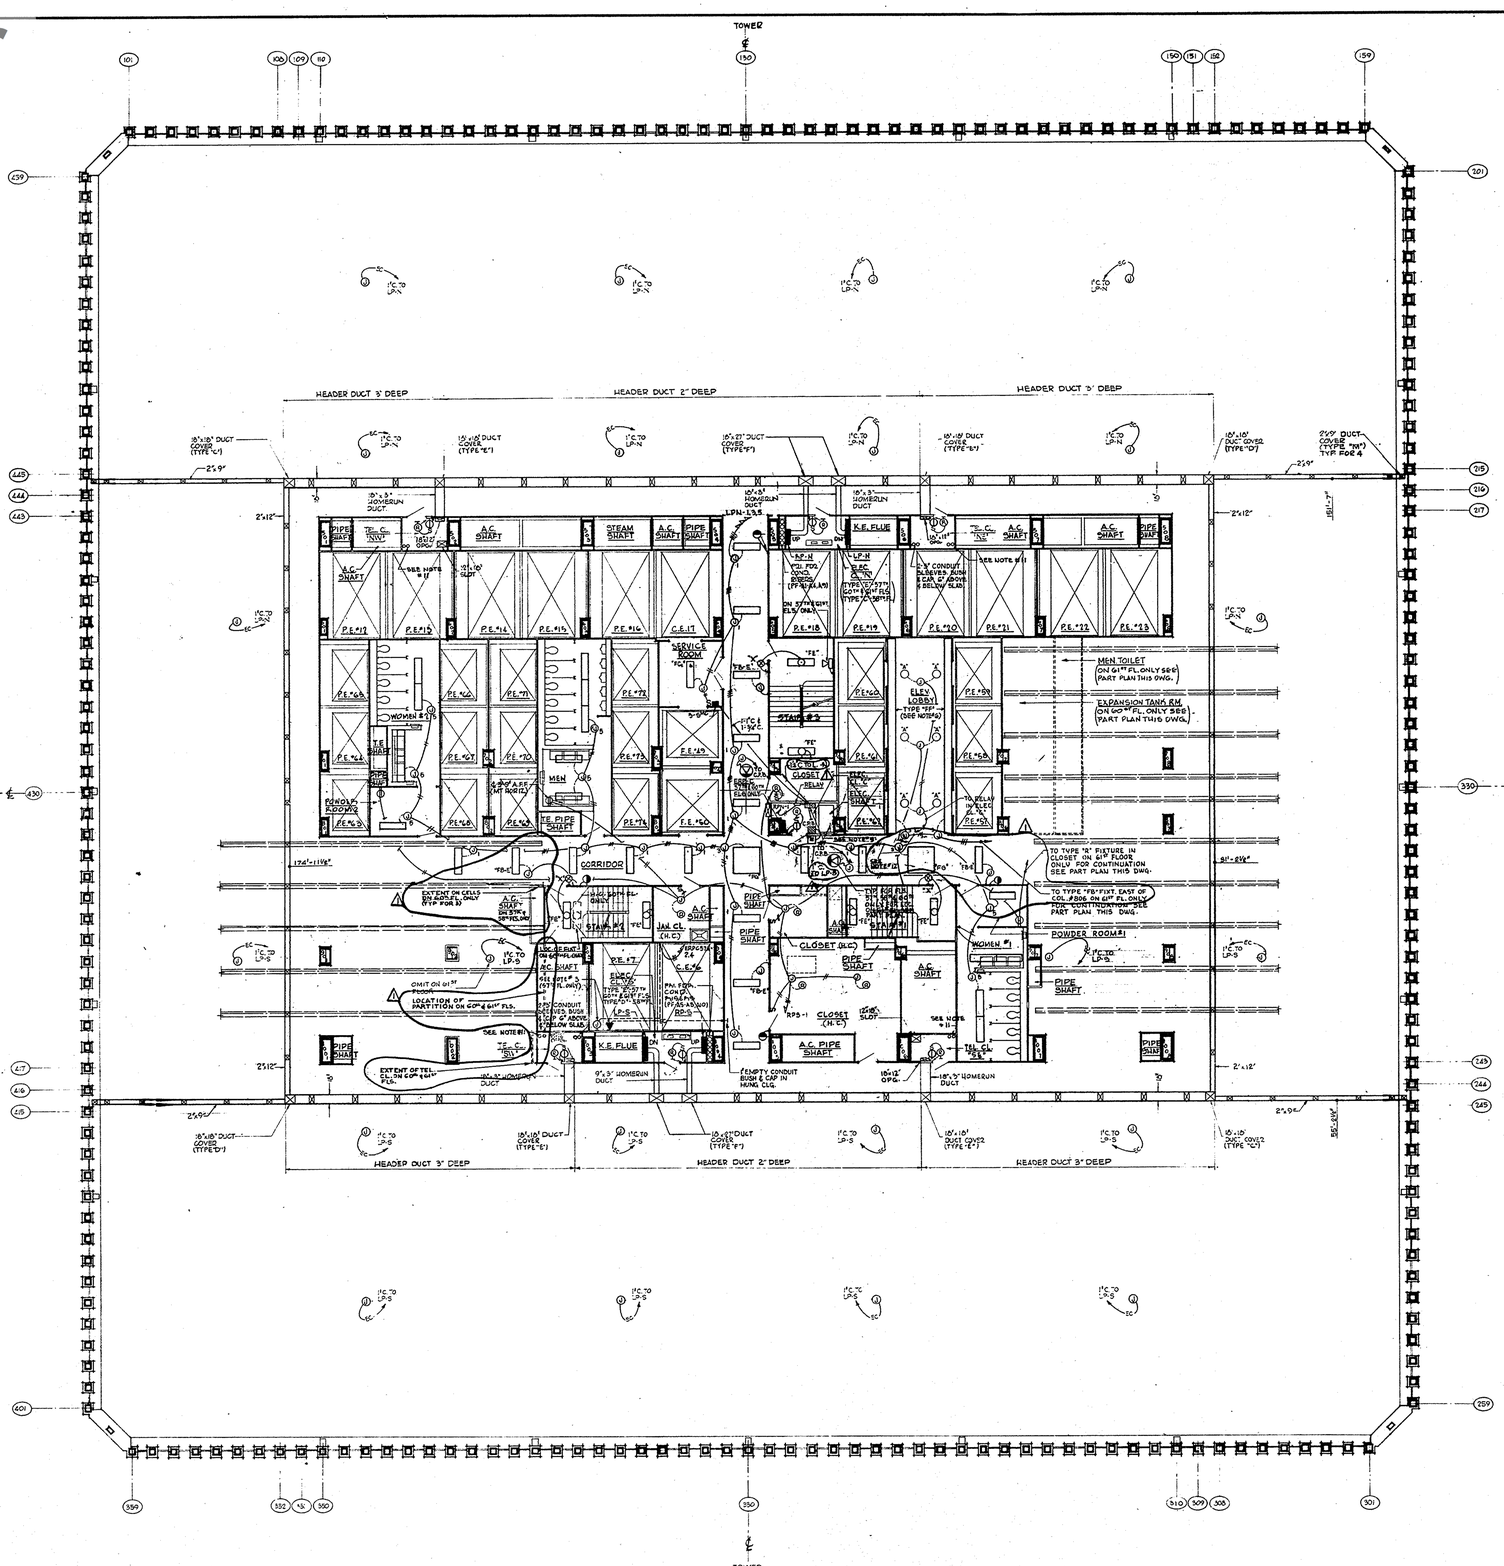


NOTES


1. UNLESS OTHERWISE SHOWN, THE ARRANGEMENT AND LOCATION OF ALL POWER AND TELEPHONE CELLS SHALL BE TYPICAL TO THAT SHOWN ON DRAWING # E-A-16.
2. REFER TO DRAWING # E-A-16 FOR ADDITIONAL ELECTRICAL FLOOR SYSTEM NOTES AND DIMENSIONS.
3. LOCATE AT CENTER OF RISER WHERE INDICATED ON APPROVED ELEVATOR SHOP DRAWINGS.
4. ALL CORRIDOR AND POWDER ROOM 1'x4' FLUORESCENT FIXTURES SHALL BE TYPE "FB" UNLESS OTHERWISE NOTED.
5. ALL TOILET ROOM FLUORESCENT FIXTURES SHALL BE TYPE "FC".
6. SPECIAL TYPE "FPF" FLUORESCENT FIXTURES IN CONTINUOUS ROW CONSISTING OF 7-4' SECTIONS.
7. VESTICAL CONDUIT RISERS FOR ALL ELECTRIC AND TELEPHONE CLOSET LIGHTS AND CONDUIT IN ELEVATOR SHAFTS SHALL BE RUN EXPOSED.
8. ALL VERTICAL CONDUIT & OUTLETS CONCEALED IN WALLS SHALL NOT BE CLOSER THAN 20" FROM FINISH DOOR OPENINGS.
9. REFER TO DRAWING # E-A-18 FOR TYPICAL WIRING DIAGRAM SHOWING METHOD OF CONTROLLING REMOTE CONTROL SWITCHES AND RELAY IN LIGHTING PANELBOARDS.
10. REFER TO DRAWING # E-A-16 FOR ADDITIONAL NOTES.
11. 2-1½" CONDUIT SLEEVES FOR FUTURE MASTER TV ANTENNA SYSTEM. BUSH AND CAP 2" ABOVE AND BELOW SLAB.
12. PROVIDE ADDITIONAL 1#12 CONDUCTOR ON 61ST FL. ONLY.

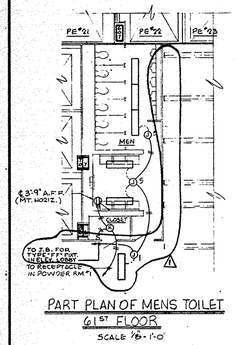

PART PLAN OF MENS TOILET
61ST FLOOR
SCALE 1/8" = 1'-0"

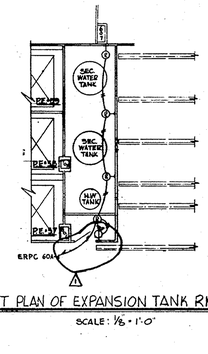

PART PLAN OF EXPANSION TANK RM. 60TH FL.
SCALE: 1/8" = 1'-0"

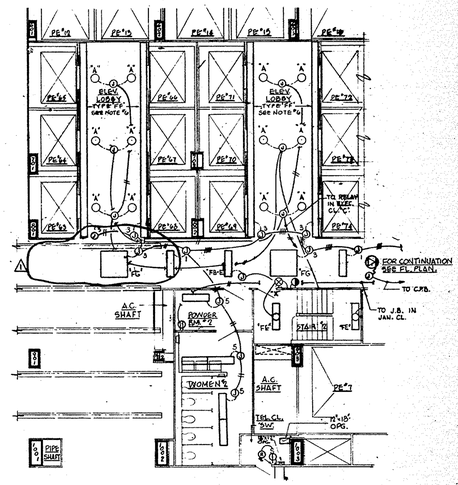

PART PLAN OF CORE AREA - 61ST FLOOR
SCALE: 1/8" = 1'-0"

SCHEDULE OF ELECTRICAL ALLOWANCES

FLOOR NO.	NET RENTABLE AREA (S.F.)	20'x100' 8 LAMP TENANT STANDARD FIXTURE. 1/350 Ⓣ TYPE "FA"	STANDARD WIRING METHOD. JUNCTION BOX IN CEILING. (BASE BID ONLY) 1/300 Ⓣ	PLUG-IN-CEILING WIRING ASSEMBLY (ALTERNATE BID ONLY) 1/450 Ⓣ	12"x48" 2-LAMP CORE CORRIDOR FIXTURE W/JUNCTION BOX IN CEILING. TYPES "FB"("FB-S"	DUPLEX RECEPTACLE FLOOR SERVICE FITTING (BASE BID ONLY) 1/125 Ⓣ	TELEPHONE FLOOR SERVICE FITTING (BASE BID ONLY) 1/400 Ⓣ	COMBINATION RECEPT-TELEPHONE FLOOR SERVICE FITTING (ALTERNATE BID ONLY) 1/120 Ⓣ
57	39,619	270	135	90	7	325	100	340
58	39,619	270	135	90	7	325	100	340
60	39,565	270	135	90	7	325	100	340
61	39,626	270	135	90	7	325	100	340

ADD 2 TYPE "X" EXIT LIGHTS PER FLOOR AS PART OF ALLOWANCES (SEE SPECIFICATIONS).

CONTRACT BID DRAWING date OCT. 16, 1967

NO.	DATE	SUB. NO.	BY
1	12-18-67		

REVISIONS

APPROVED

CHIEF, PLANNING DIVISION

DATE

THE WORLD TRADE CENTER

THE PORT OF NEW YORK AUTHORITY

MINORU YAMASAKI & ASSOCIATES
MINORU YAMASAKI, ARCHITECT

WORTHINGTON, SKILLING, HELLE & JACKSON
STRUCTURAL ENGINEERS

JOSEPH R. LORING & ASSOCIATES
ELECTRICAL ENGINEERS

EMERY ROTH & SONS
RICHARD ROTH, ARCHITECT

JAROS, BAUM & BOLLES
MECHANICAL ENGINEERS

THE PORT OF NEW YORK AUTHORITY
PAVING, UTILITIES, FOUNDATIONS

1/8" = 1'-0" scale 2 0 5 10 15 20 feet

TITLE: LIGHTING AND POWER 57TH AND 58TH, 60TH AND 61ST FLOORS

DRAWN	R.F.H.	CHECKED	J.R.L.
SCALE	1/8" = 1'-0"	DATE	OCT. 16, 1967
PROJECT NUMBER		SHEET	52 OF 114
DRAWING NUMBER	E-A-36		