

FileJuicer

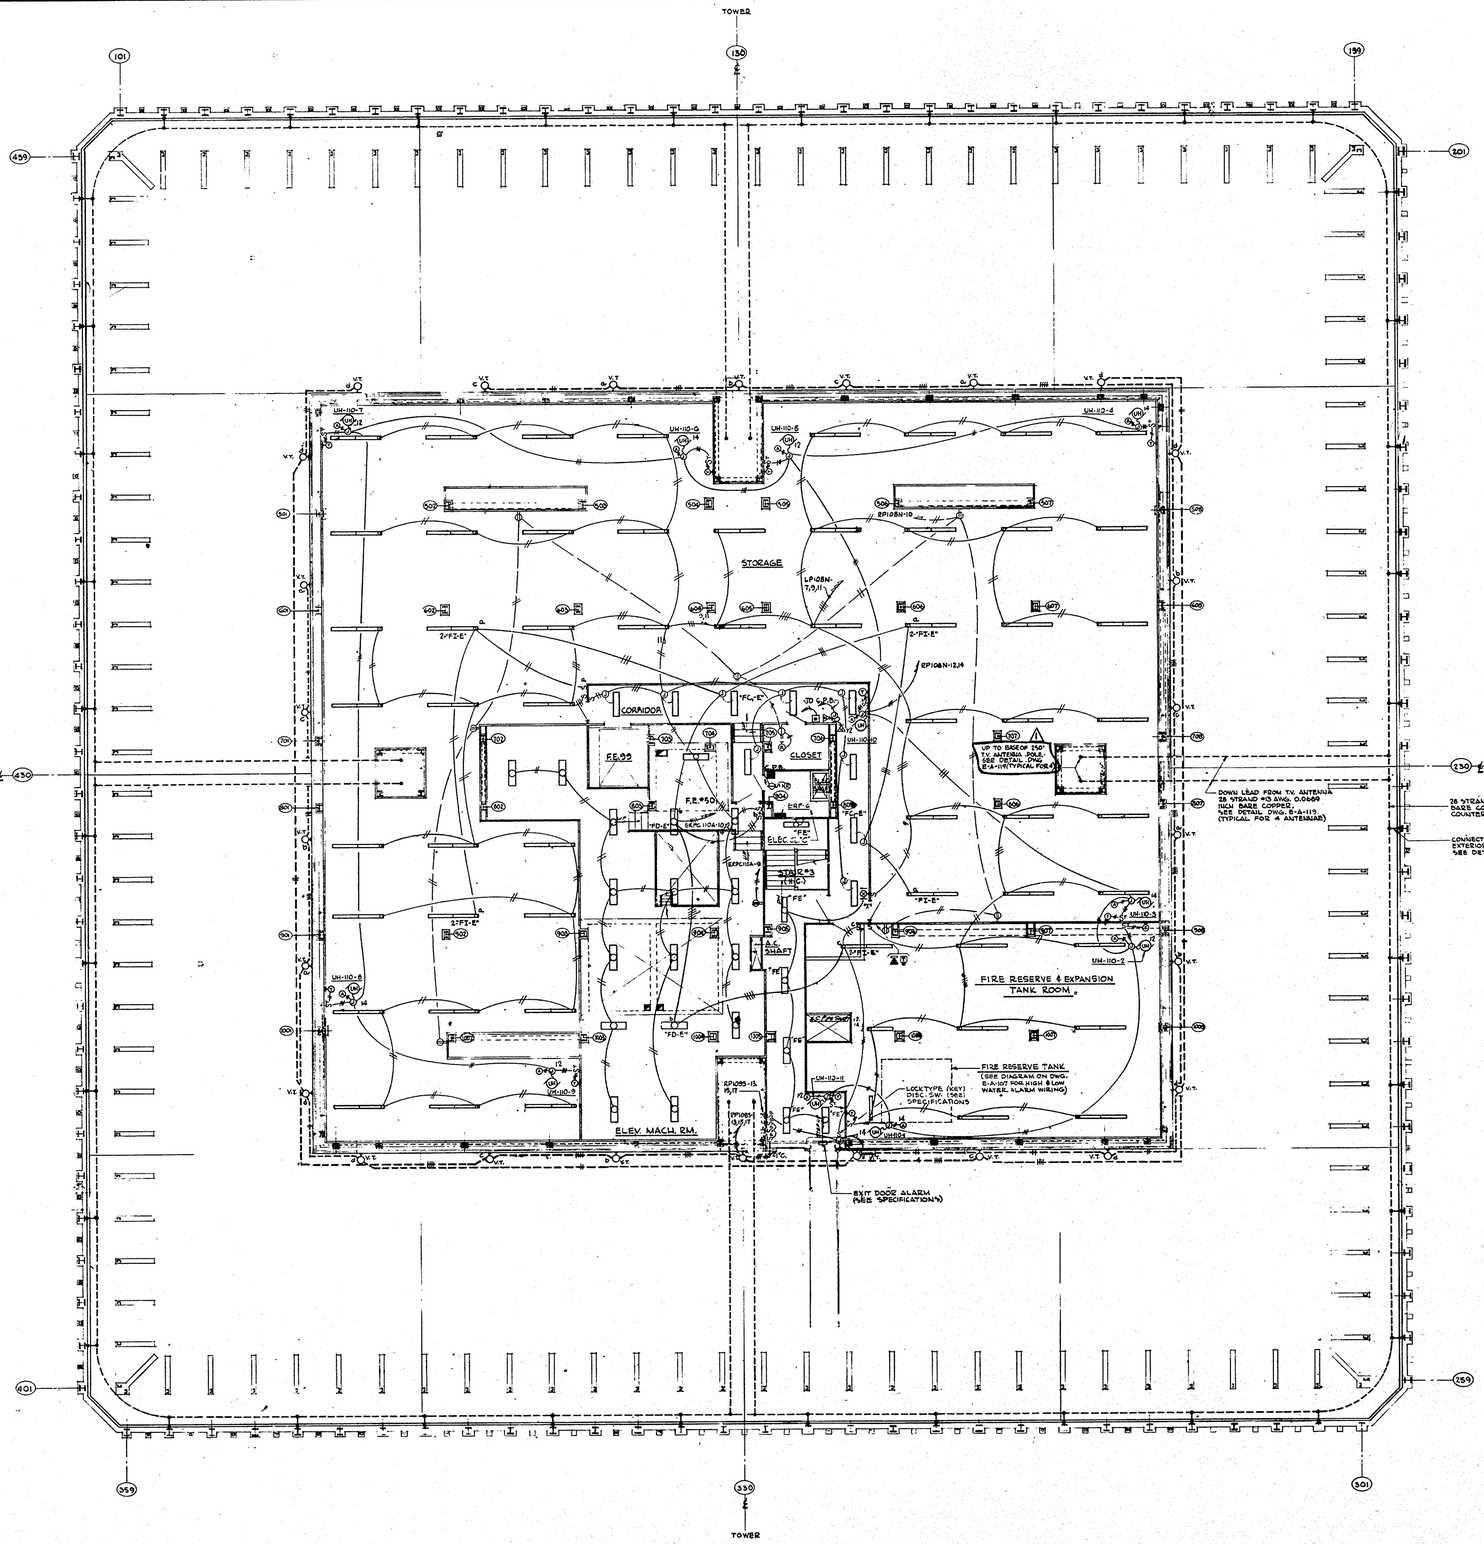

NOTES:

1. ALL STORAGE, FIRE RESERVE & EXPANSION TANK ROOM FLUORESCENT FIXTURES SHALL BE TYPE "F1" (12'-0" A.F.F.) UNLESS OTHERWISE NOTED
2. ALL ELEVATOR MACHINE ROOM FLUORESCENT FIXTURES SHALL BE TYPE "F2" (10'-0" A.F.F.) UNLESS OTHERWISE NOTED
3. ALL CORRIDOR FLUORESCENT FIXTURES SHALL BE TYPE "FC" UNLESS OTHERWISE NOTED.
4. ALL VERT. COND. OUTLETS CONCEALED IN WALLS SHALL NOT BE CLOSER THAN 20" FROM FINISH DOOR OPENING.
5. ALL INCANDESCENT LIGHTING FIXTURES AROUND PERIMETER OF PENTHOUSE (OUTSIDE) SHALL BE TYPE "B" (VAPORPROOF) 7'-0" A.F.F. UNLESS OTHERWISE NOTED.
6. REFER TO DRAWING E-A-116 FOR ADDITIONAL NOTES.

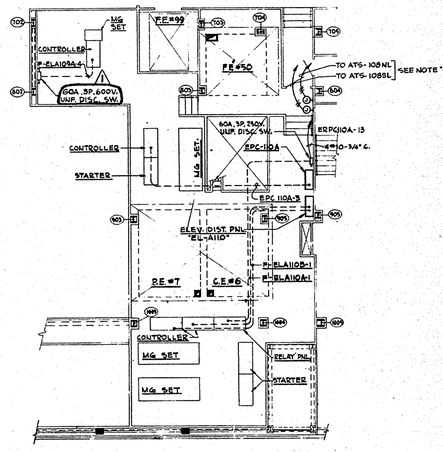

PART PLAN OF ELEVATOR MACHINE ROOM - 110TH FLOOR (POWER)

SCALE: 1/8" = 1'-0"

NOTES:

A. ALL CONNECTIONS TO ALL ELEVATOR EQUIPMENT SHALL BE MADE IN ACCORDANCE WITH APPROVED ELEVATOR SHOP DRAWINGS.

B. ELECTRICAL CONTRACTOR SHALL COORDINATE WITH THE ELEVATOR CONTRACTOR FOR POSSIBLE COMMON USE OF A WIRING TROUGH OVER THE ELEVATOR PANEL LINE-UPS IN LIEU OF USING SEPARATE CONDUIT RUNS TO THIS EQUIPMENT.

C. REFER TO DWG # E-X-11 FOR ELEVATOR CONTROL RISER DIAGRAM.

1/8" = 1'0" scale 5 0 5 10 15 20 feet

CONTRACT BID DRAWING date OCT. 16, 1967

NO.	DATE	SUB. NO.	BY	NO.	DATE	SUB. NO.	BY
1	11-15-67						

REVISIONS

APPROVED

CHIEF, PLANNING DIVISION

DATE

THE WORLD TRADE CENTER

THE PORT OF NEW YORK AUTHORITY

MINORU YAMASAKI & ASSOCIATES MINORU YAMASAKI, ARCHITECT	EMERY ROTH & SONS RICHARD ROTH, ARCHITECT
WORTHINGTON, SKILLING, HELLE & JACKSON STRUCTURAL ENGINEERS	JAROS, BAUM & BOLLES MECHANICAL ENGINEERS
JOSEPH R. LORING & ASSOCIATES ELECTRICAL ENGINEERS	THE PORT OF NEW YORK AUTHORITY PAVING, UTILITIES, FOUNDATIONS

TITLE: LIGHTING AND POWER 110TH FLOOR

DRAWN	R.F.H.	CHECKED	J.R.L.
SCALE	1/8"=1'-0"	DATE	OCT. 16, 1967
PROJECT NUMBER		SHEET	61 OF 114
DRAWING NUMBER	E-A-67		