
date	REVISIONS	no.
2-21-84	SUBMITTED TO P.A. FOR REVIEW	
4-7-84	REVISED AS PER P.A. COMMENTS	1
10-84	SUBMITTED TO P.A. FOR REVIEW	
11-6-84	SUBMITTED TO P.A. 502 REVIEW.	

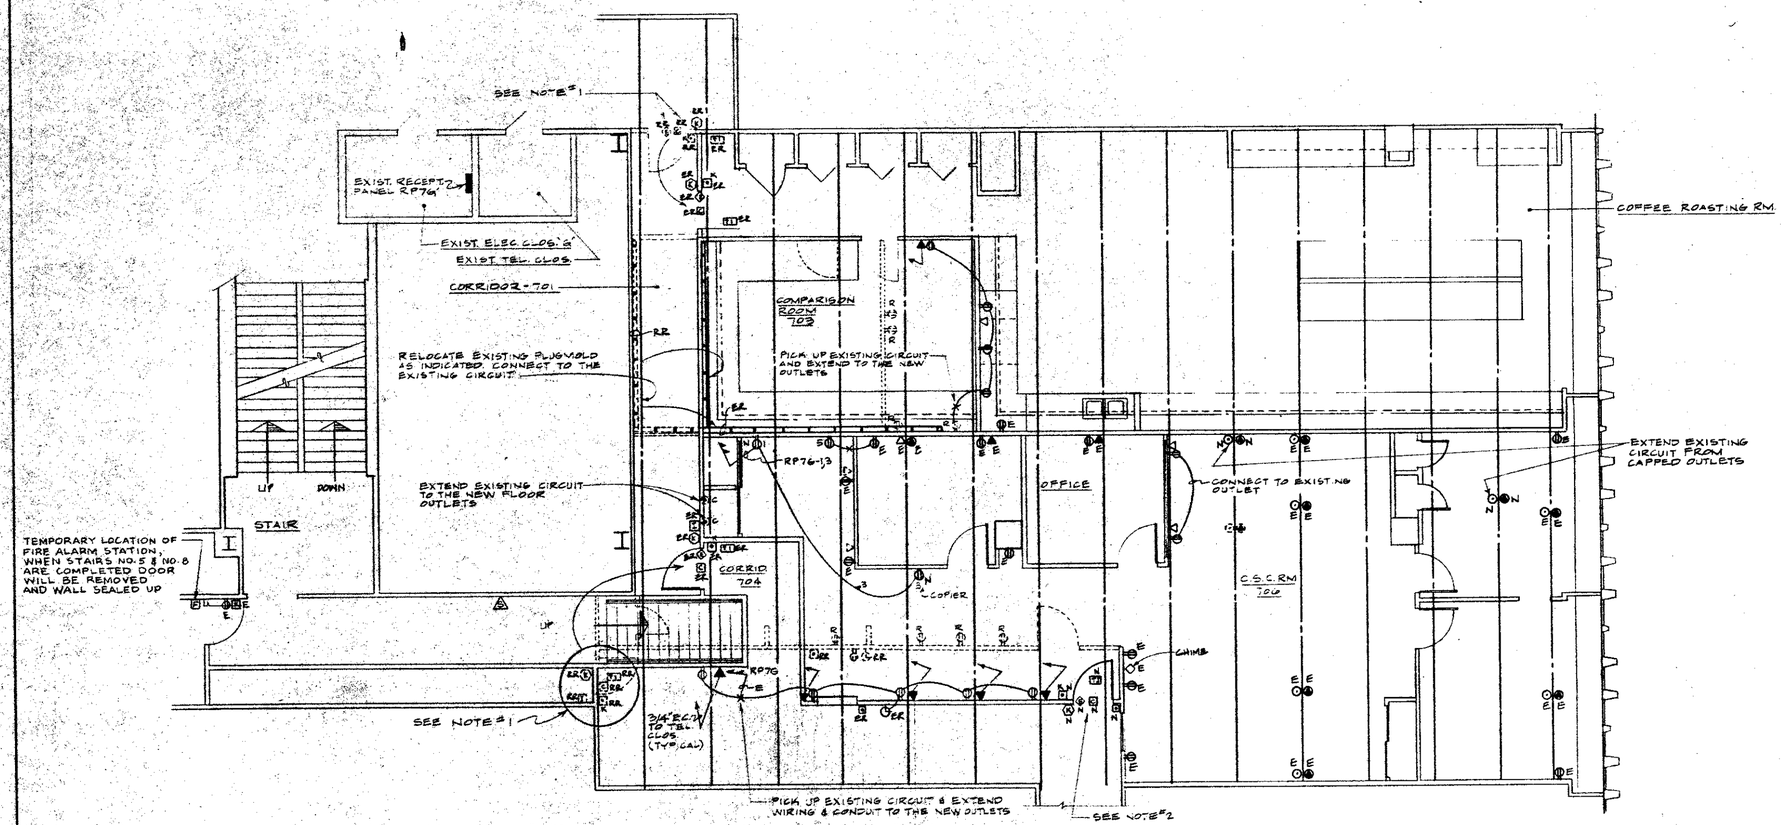

NOTES:

1. WHERE EXISTING CARD KEY SYSTEM, INTERCOM SYSTEM, PUSH BUTTONS, DOOR CONTACTS BEING RELOCATED, CONTRACTOR TO EXTEND WIRING & CONDUIT AS REQUIRED
2. NEW CARD KEY SYSTEM SHALL MATCH EXISTING DEVICES MAKE ALL NECESSARY CONNECTIONS TO WIRING BETWEEN PUSH BUTTON RELEASE, CARD KEY & TERMINAL INTERFACE DOOR CONTACTS AND 8TH FLOOR GUARD STATION AS REQUIRED.
3. THE NUMBER OF GENERAL PURPOSE OUTLETS SHALL NOT EXCEED 8 (EIGHT) ON EACH BRANCH CIRCUIT.

MSJ | MEYER STRONG & JONES, P.C. MECHANICAL & ELECTRICAL ENGINEERS 270 PARK AVE NEW YORK N.Y. 10017

SONSIGNORE BRIGNATI & MAZZOTTA, P.C. ARCHITECTS 270 SEVENTH AVENUE NEW YORK NEW YORK 10001 (212) 989 8900

CEC
COMMODITIES EXCHANGE CENTER, INC.
FOUR WORLD TRADE CENTER
NEW YORK, NEW YORK 10048

EGRESS UPGRADE
PHASE 1
AREA H

7TH FLOOR
POWER PLAN

project 1930
scale 1/4"=1'-0"
date 2-21-84

dwg E-1