
date	REVISIONS	no.
2-21-84	SUBMITTED TO P.A. FOR REVIEW	
9-7-84	REVISED AS PER P.A. COMMENTS	1
10-5-84	SUBMITTED TO P.A. FOR REVIEW	
11-16-84	GENERAL REVISION SUBMITTED TO P.A. FOR REVIEW.	2

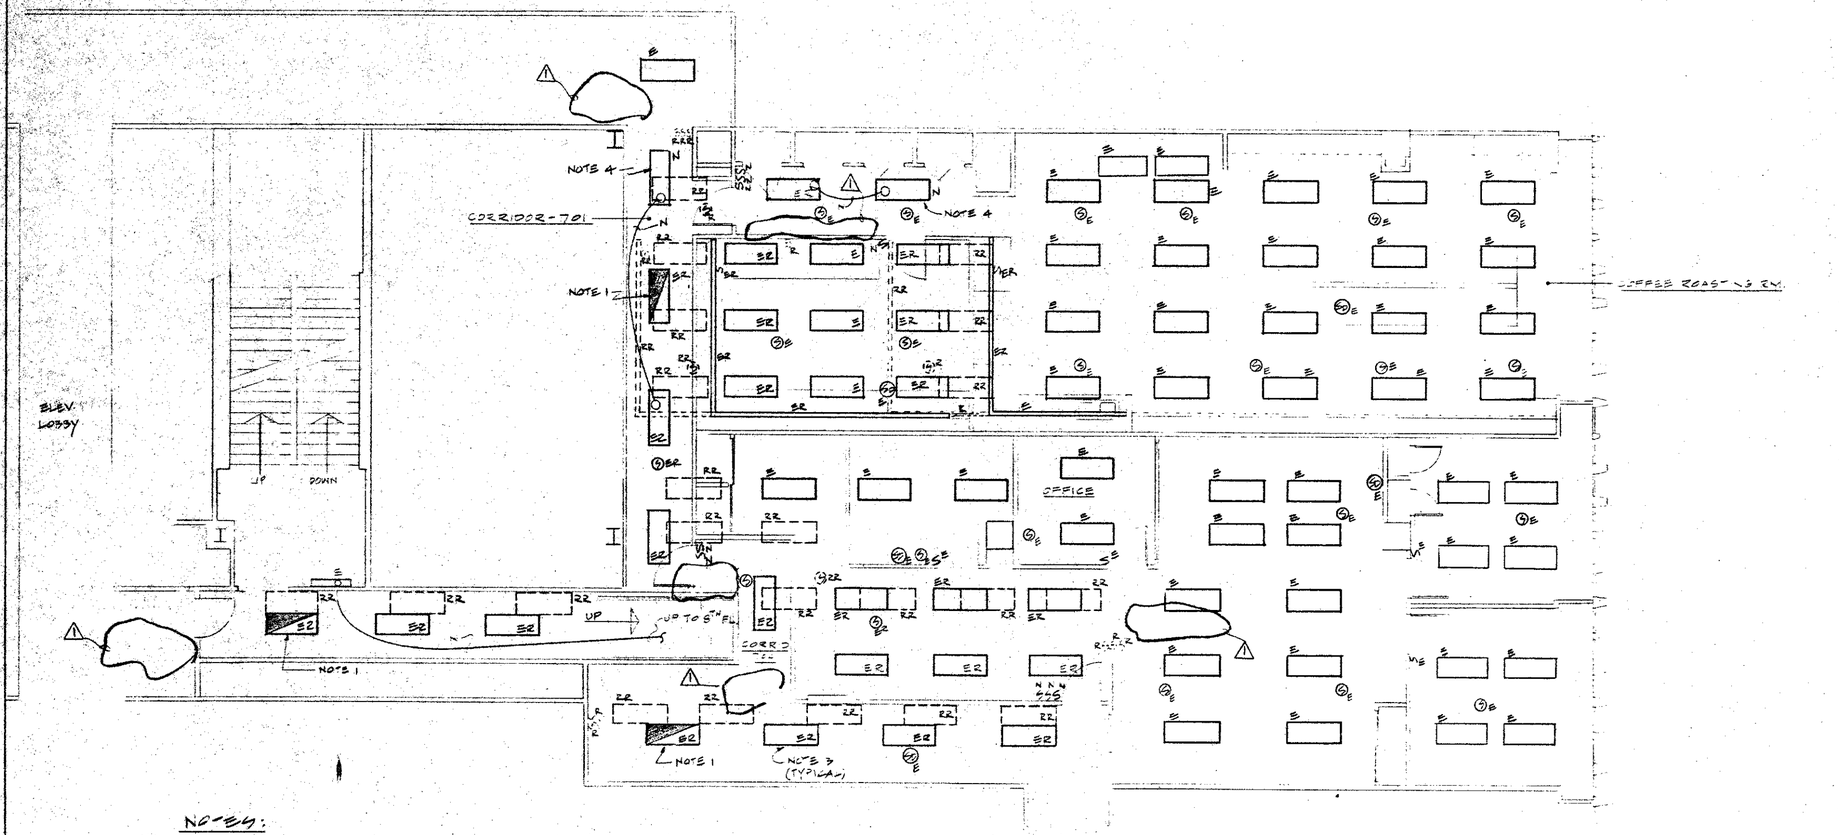

NOTES:

1. CONNECT TO EXISTING EMERGENCY LIGHT CIRCUIT.
2. EZR SYMBOL UNIT SEE DWG. E-3.
3. CONNECT RELOCATED LIGHTING FIXTURE TO NEW SWITCHES AND EXISTING CIRCUITS.
4. ALL NEW 2x4 LIGHTING FIXTURES TO MATCH EXISTING. CONNECT NEW LIGHTING FIXTURES TO EXISTING LIGHTING CIRCUIT AS SHOWN.

COMMODITIES EXCHANGE CENTER, INC.
FOUR WORLD TRADE CENTER
NEW YORK, NEW YORK 10048

EGRESS UPGRADE
PHASE 1
AREA H

7TH FLOOR LIGHTING PLAN

MS&J MEYER STRONG & JONES, PC
MECHANICAL & ELECTRICAL ENGINEERS
230 PARK AVE NEW YORK N.Y. 10017

SONSIGNORE BRIGNATI & MAZZOTTA, P.C. ARCHITECTS

project 1930
scale 1-4=1-0"
date 2-21-84

dwg no 1-E-2