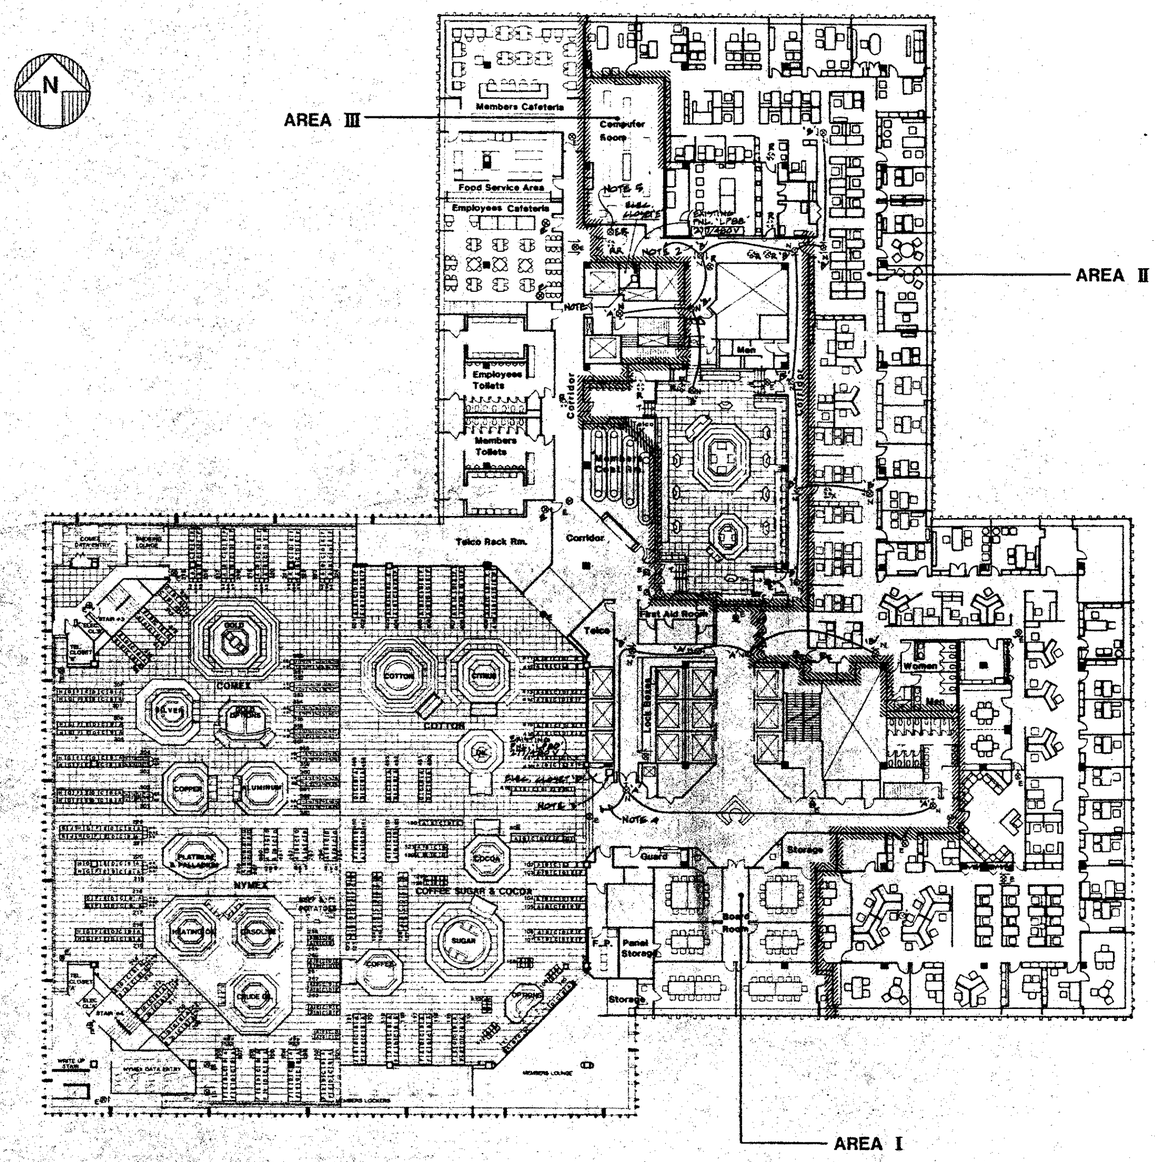


8TH FLOOR AREA OF REFUGE PLAN (NEW CONDITIONS)

NOTES:

1. NEW FUSE CUTOUT PANEL: 2P, 20A, 3W, WITH SOLID NEUTRAL. TAP LINE SIDE OF EXISTING LIGHTING PANEL 'LPBE'. RUN 3#12 - 3/4"C.
2. CONNECT EXIT LIGHT CIRCUIT TO NEW FUSE CUTOUT PANEL IN ELEC. CLOSET 'E'.
3. NEW FUSE CUTOUT PANEL: 2P, 20A, 3W, WITH SOLID NEUTRAL. TAP LINE SIDE OF EXISTING LIGHTING PANEL 'LPDD'. RUN 3#12 - 3/4"C.
4. CONNECT EXIT LIGHT CIRCUIT TO NEW FUSE CUTOUT PANEL IN ELEC. CLOSET 'D'.
5. FOR EXISTING RELOCATED EXIT SIGN, EXTEND EXISTING WIRING AND CONDUIT TO THE NEW LOCATION.

date	REVISIONS	no.
10/5/84	SUBMITTED TO P.A. FOR REVIEW	
11-6-84	GENERAL REVISION. SUBMITTED TO P.A. FOR REVIEW.	1

CEC
COMMODITIES EXCHANGE CENTER, INC.
FOUR WORLD TRADE CENTER
NEW YORK, NEW YORK 10048

EGRESS UPGRADE
PHASE 1 & 2

dwg. title:
8TH FLOOR
EXIT LIGHTING PLAN

MS&J MEYER STRONG & JONES, P.C.
MECHANICAL & ELECTRICAL ENGINEERS
230 PARK AVE NEW YORK, N.Y. 10169

SONSIDONORE BRIGNATI & MAZZOTTA, P.C. ARCHITECTS
370 SEVENTH AVENUE NEW YORK, NEW YORK 10001 (212) 868-8200

project 1930
scale 1/0 SCALE
date 10-8-84

dwg no.
I-E-5