

date	REVISIONS	no.
2-21-84	SUBMITTED TO P.A. FOR REVIEW	
9-7-84	REVISED AS PER P.A. COMMENTS.	1
11/6/84	SUBMITTED TO P.A. FOR REVIEW	
11-6-84	GENERAL REVISION. SUBMITTED TO P.A. FOR REVIEW.	2

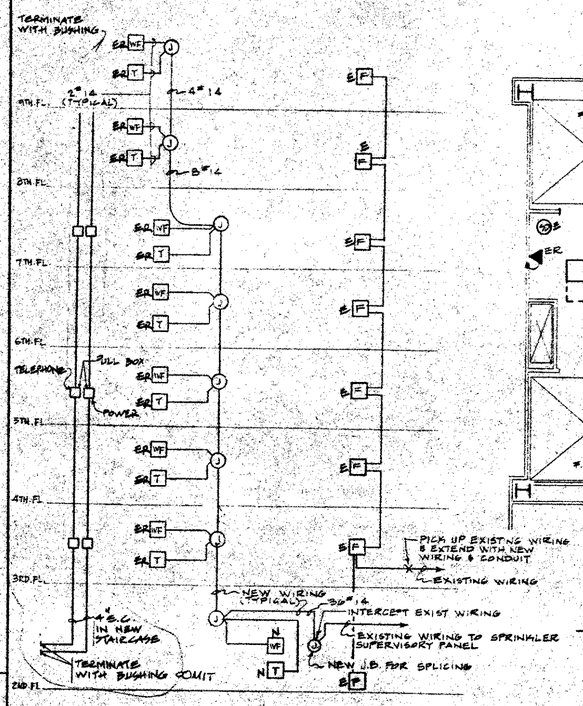

SPRINKLER WATER FLOW & FIRE ALARM SYSTEM RISER

SCALE: NOT TO SCALE


NOTE 1. WATERFLOW SWITCH & TAMPER SWITCH SHALL BE CONNECTED WITH TEFLON INSULATED WIRE RUN IN RIGID STEEL CONDUIT.

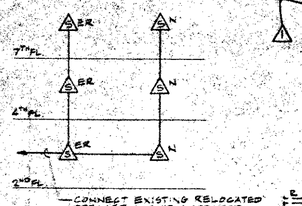

STAIR SPEAKER RISER


SCALE: NOT TO SCALE

NOTES:
1. NEW SPEAKER SHALL MATCH EXISTING STAIR SPEAKER. COVERAGE SHALL BE THE SAME AS EXISTING.
2. SPEAKER SHALL BE CONNECTED WITH TEFLON INSULATED WIRE RUN IN RIGID STEEL CONDUIT.

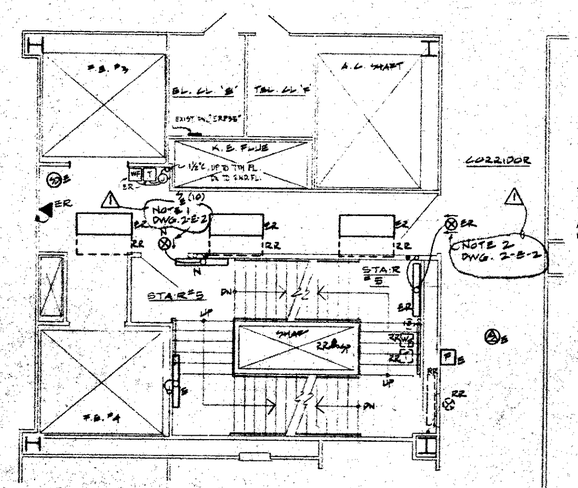


PART PLAN OF 3RD FLOOR

SCALE: 1/4" = 1'-0"

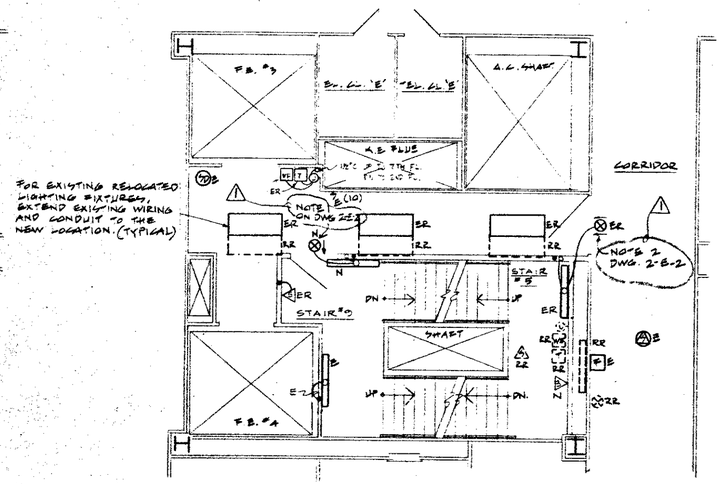

PART PLAN OF 4TH FLOOR


SCALE: 1/4" = 1'-0"

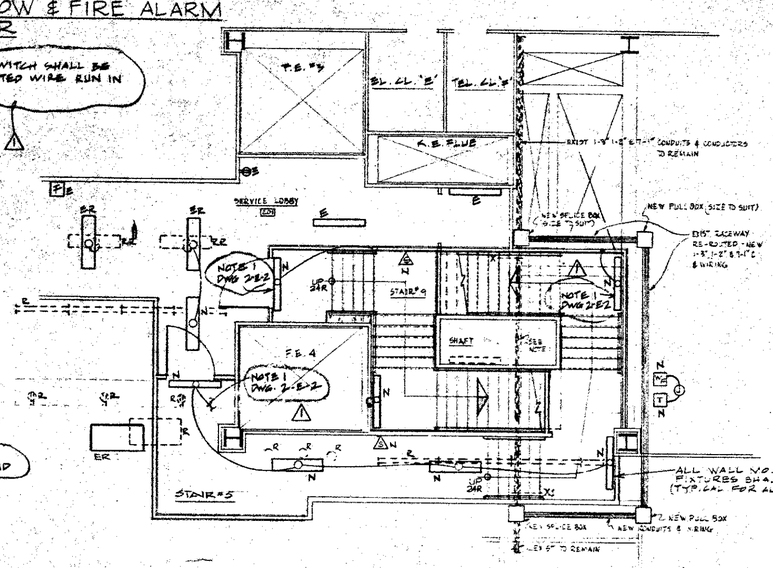

PART PLAN OF SECOND FLOOR

SCALE: 1/4" = 1'-0"

NOTE - 1. INTERCEPT EXIST. 1-3", 1-2" & 1-1" RACEWAY AT X.X. AND REMOVE SECTION "X-X" COMPLETELY.

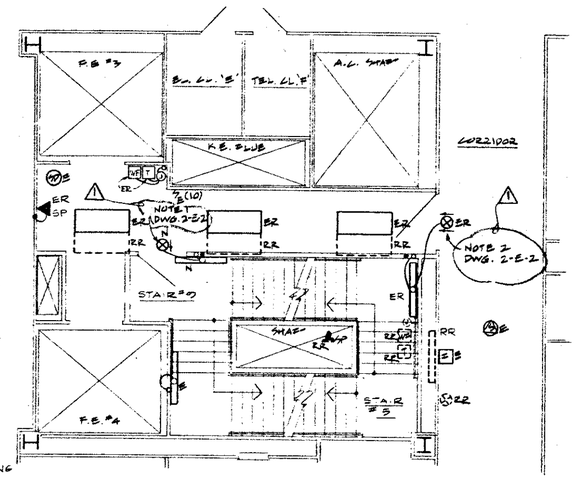

PART PLAN OF 5TH FLOOR

MS&J MEYER STRONG & JONES, PC
MECHANICAL & ELECTRICAL ENGINEERS
270 PARK AVE NEW YORK, N.Y. 10017

SONSIONORE BRIGNATI & MAZZOTTA, P.C. ARCHITECTS
370 SEVENTH AVENUE NEW YORK NEW YORK 10001 (212) 868 8800

CEC
COMMODITIES EXCHANGE CENTER, INC.
FOUR WORLD TRADE CENTER
NEW YORK, NEW YORK 10048

EGRESS UPGRADE
PHASE 2
AREA D

PART PLANS - 2ND, 3RD, 4TH & 5TH FLOOR LIGHTING, POWER & SIGNAL

project 1930
scale AS NOTED
date 2-21-84

dwg no. 2-E-1