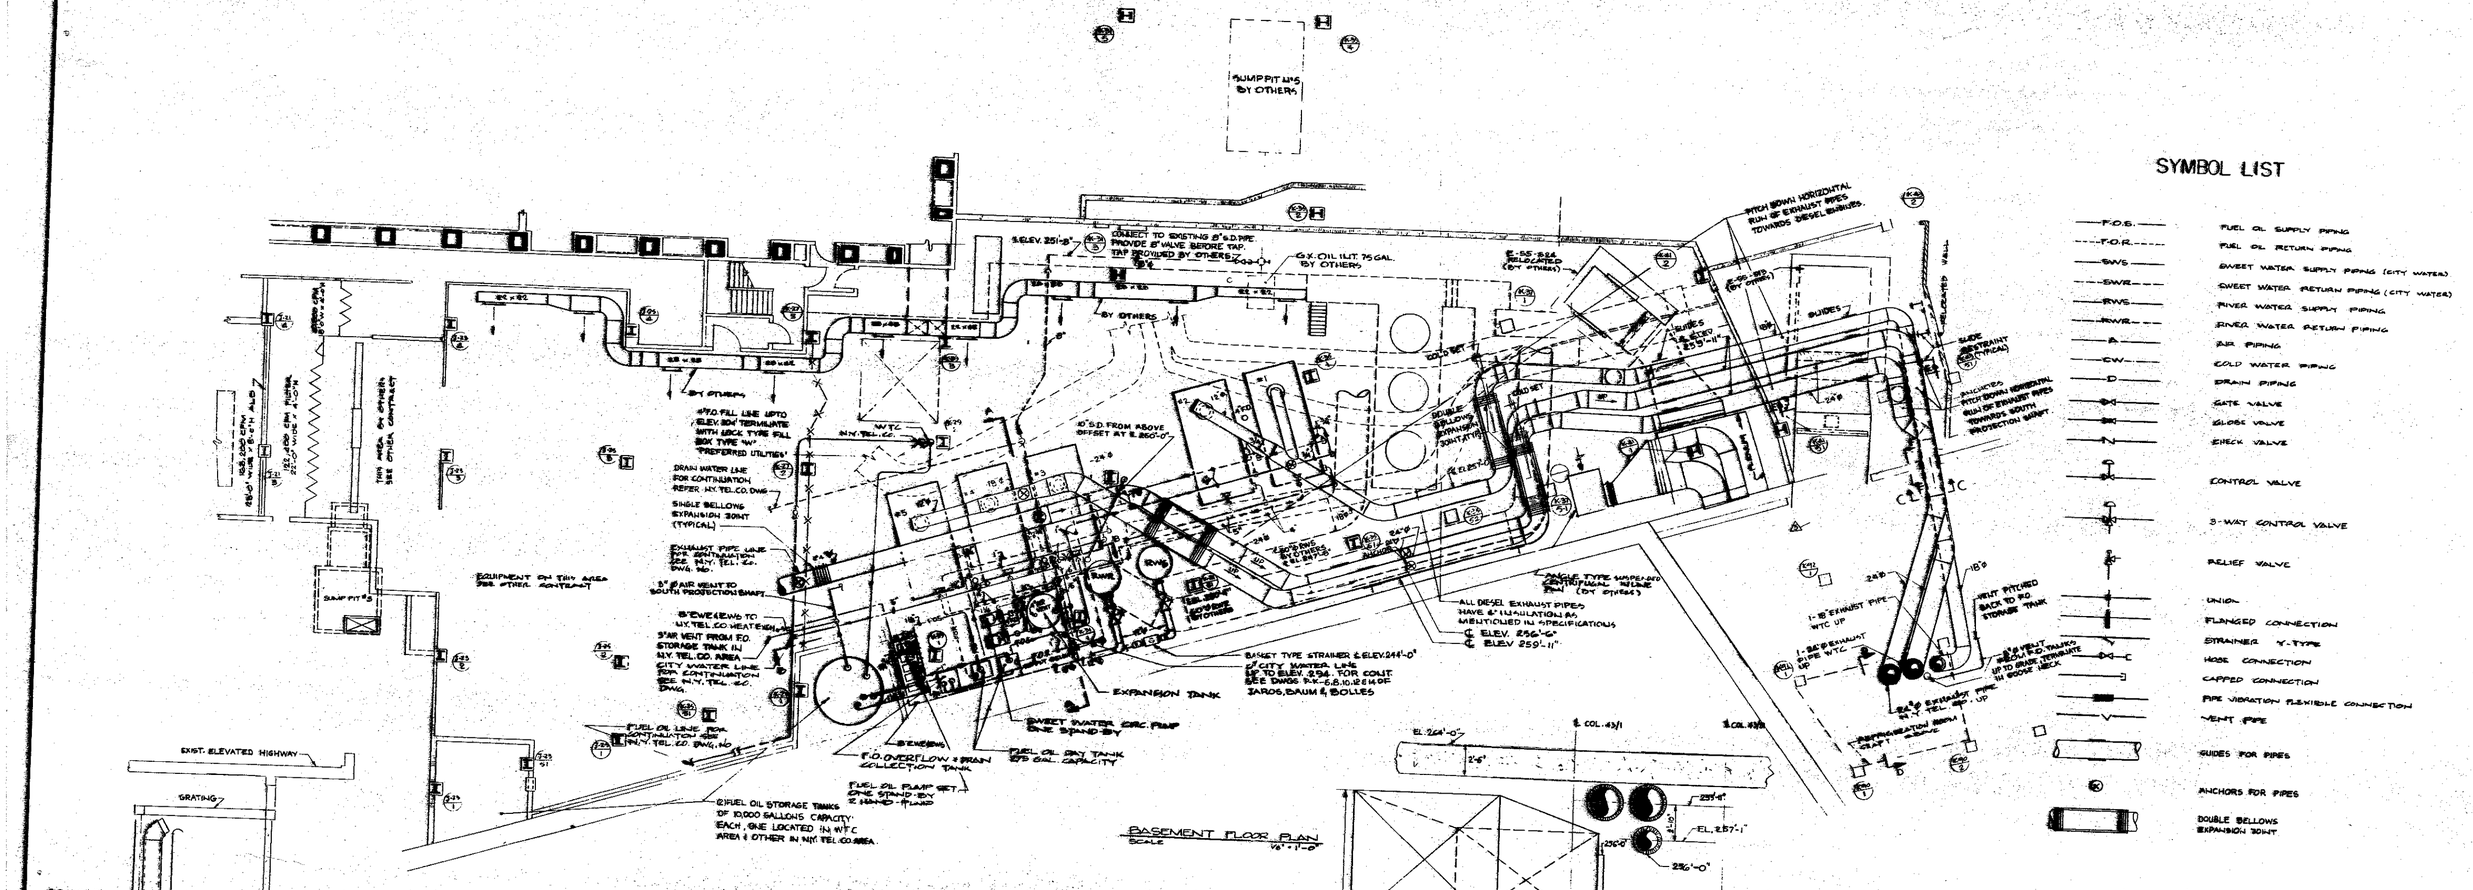


FUEL OIL PUMP SCHEDULE

UNIT NO.	HP	QTY	RPM	FROM SUCT. TANK GPM	AT RATED HEAD PSI	SERVICE	TYPE
P-G-1	1/2	1	1800	2.5	45-0	TRANSFER	ROTARY PUMP
P-G-2	1/2	1	1800	2.7	85-0	DAY TANK NO. 2	ROTARY PUMP
P-G-3	1/2	1	1800	2.5	85-0	DAY TANK NO. 1	ROTARY PUMP
P-G-4	1/2	1	1800	2.7	85-0	BURNER NO. 1	ROTARY PUMP
SPARE		1				BURNER NO. 2	ROTARY PUMP

SWEET WATER CIRCULATING PUMP

GP-G-1 (SPARE 1 STAND-BY)	15.00 GPM	140 FEET	1/2 HP	1750 R.P.M.	SINGLE STAGE, END SUCTION

CONTRACT BID DRAWING MAY 1, 1970

NO.	DATE	REVISIONS	BY
3	8-15-70	GP-9	A.G.
2	10-1-70		A.G.
1	7-22-70		A.G.

APPROVED
CHIEF, PLANNING DIVISION
DATE

THE WORLD TRADE CENTER
THE PORT OF NEW YORK AUTHORITY

MINORU YAMASAKI & ASSOCIATES
MINORU YAMASAKI, ARCHITECT

EMERY ROTH & SONS
RICHARD ROTH, ARCHITECT

WORTHINGTON, SKILLING, HELLE & JACKSON
STRUCTURAL ENGINEERS

JAROS, BAUM & BOLLES
MECHANICAL ENGINEERS

JOSEPH R. LORING & ASSOCIATES
ELECTRICAL ENGINEERS

THE PORT OF NEW YORK AUTHORITY
PAVING, UTILITIES, FOUNDATIONS

TITLE: EMERGENCY GENERATOR ROOM PLAN, SECTIONS & SYMBOL LIST

DRAWN	L.U.	CHECKED	A.G.
SCALE	1/8" = 1'-0"	DATE	MAY 1, 1970
PROJECT NUMBER	1504-80	SHEET	1 OF 6
DRAWING NUMBER	M-G-1		