
SKILLING, HELLE, CHRISTIANSEN, ROBERTSON — Structural & Civil Engineers

PROJECT: THE WORLD TRADE CENTER | TITLE: TYPICAL DETAILS AT SUB-LEVEL #3, EL. 264' | DATE: 5-1-68

REVISIONS

GENERAL REVISION 1-17-69

5-9-69

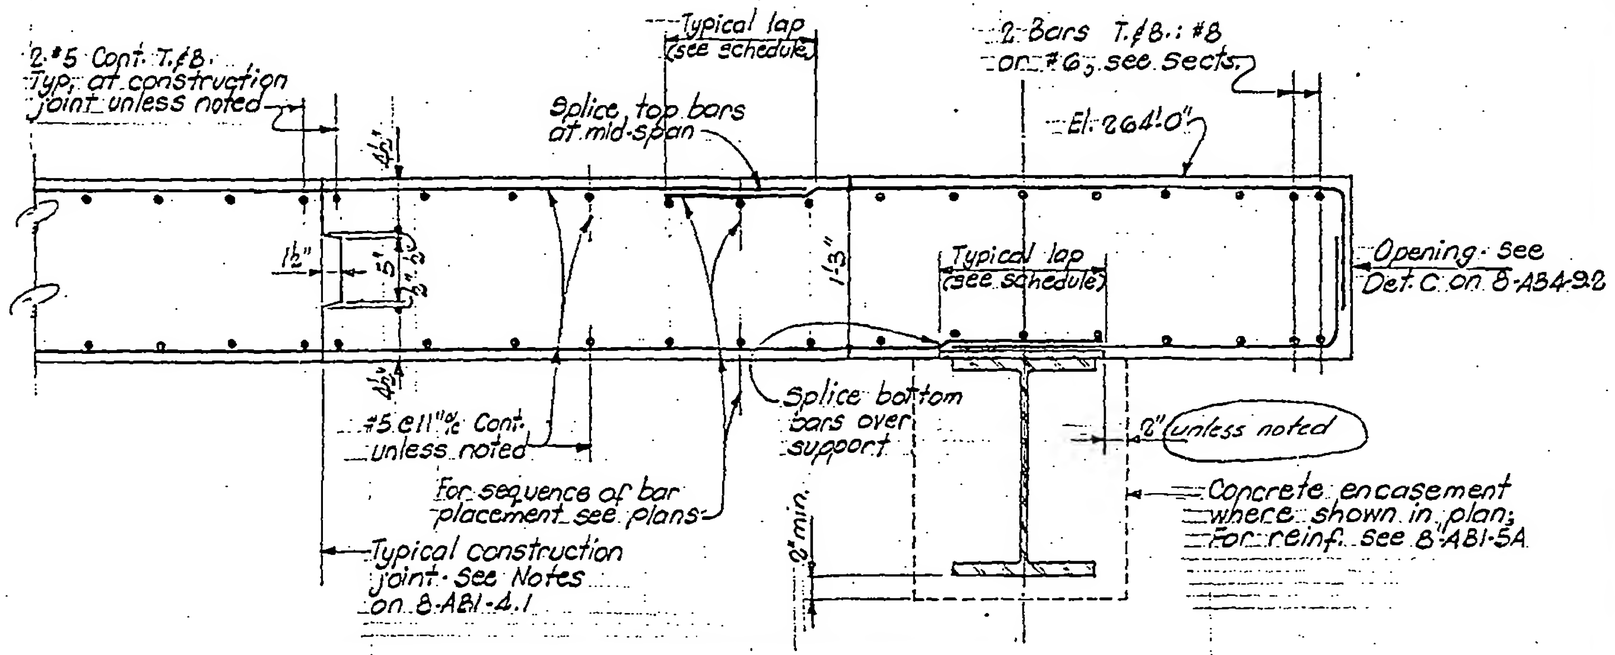

SECTION A-A THRU TYPICAL SLAB

NOTES:

1. Sheets 8-AB1 apply to sub-level #3 except as modified.
2. On #5 bars and larger use 90° hooks where possible, regardless of the shape of hook indicated in details.
3. Dowels may be used at construction joints. They shall be equal in size and number to the slab reinforcing bars, and shall overlap them by the length of Typical Lap shown in Schedule.
4. Stagger lap splices. See Note #5 on 8-AB1-2.2.
5. The number of bars given as "T.&B." is to be doubled to obtain the total quantity. See note #11 on 8-AB1-2.2.

LAP SCHEDULE	
2'-3"	for #5
2'-9"	for #6
3'-3"	for #7
3'-6"	for #8
4'-0"	for #9
5'-0"	for #10
6'-0"	for #11

LICENSED PROFESSIONAL ENGINEER — LESLIE E. ROBERTSON — No. 34360 — UNIVERSITY OF THE STATE OF NEW YORK

DESIGNED

DRAWN S.T.M.

REVIEWED

8-AB4-9.1