
SKILLING, HELLE, CHRISTIANSEN, ROBERTSON — Structural & Civil Engineers

PROJECT: THE WORLD TRADE CENTER | TITLE: ELEVATOR C9 - SECTIONS | DATE: 4-29-69

REVISIONS
5-26-69
9-29-69
10-8-69
3-31-70

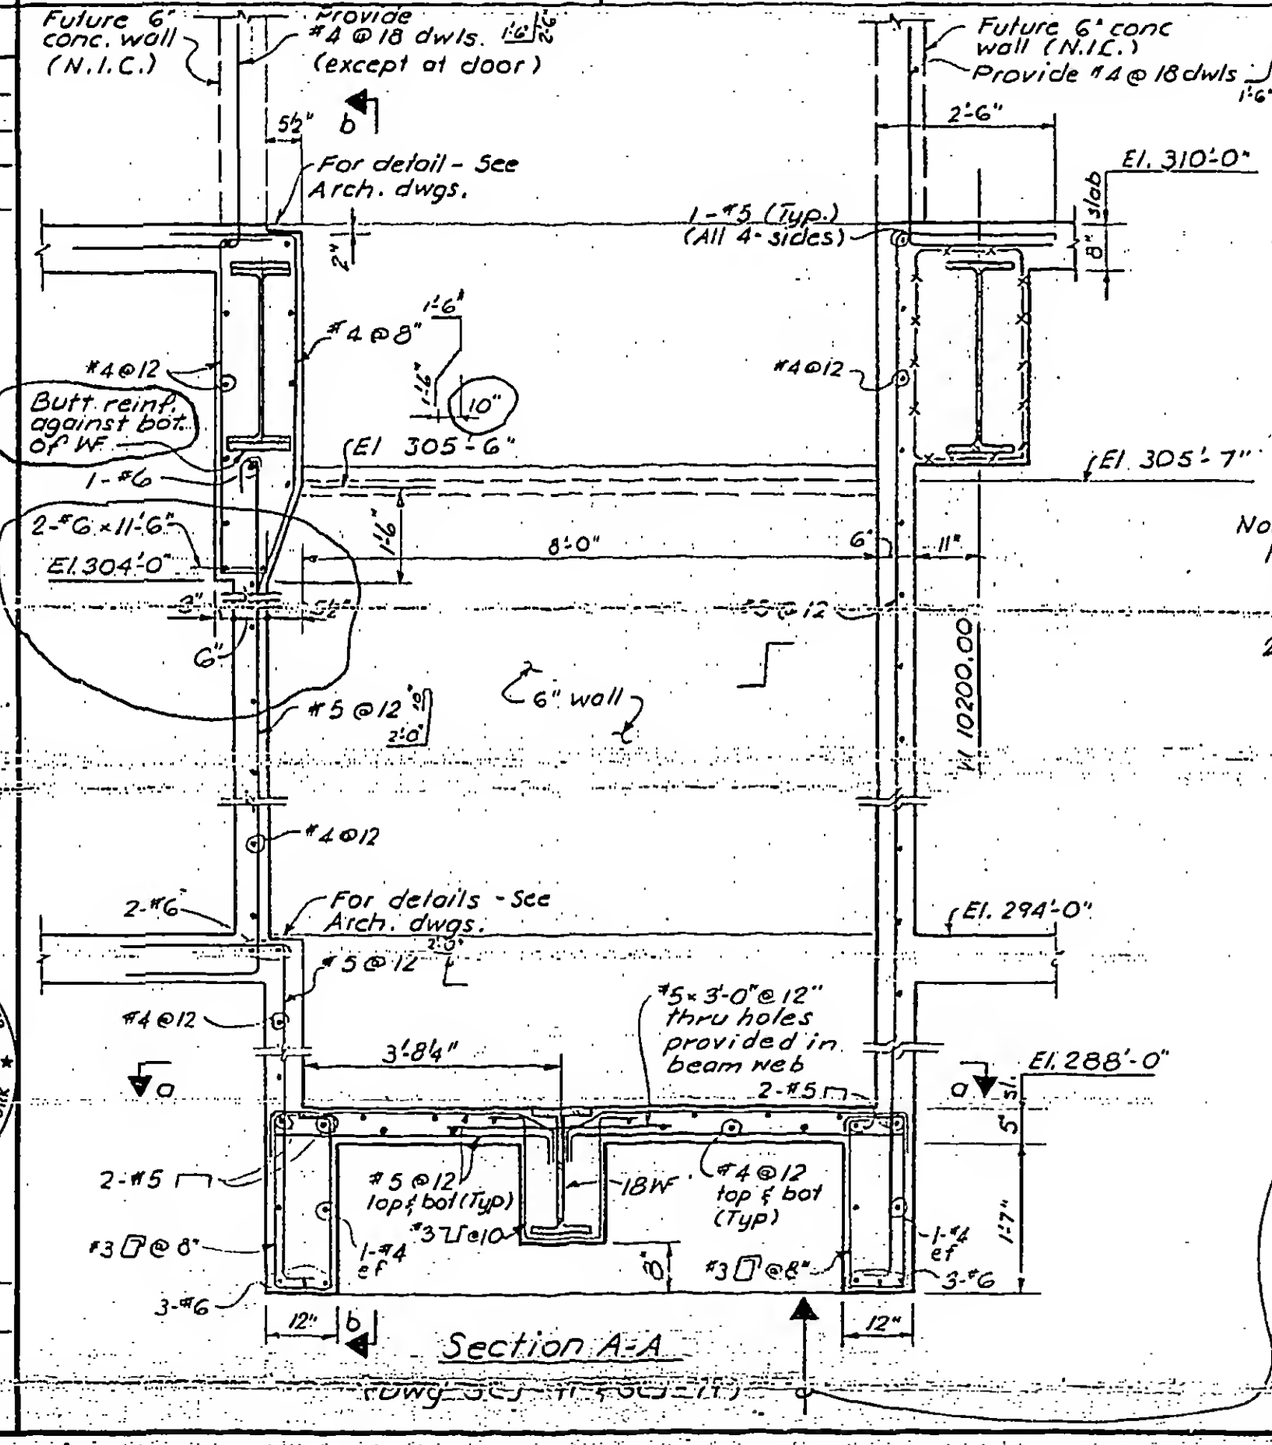

Notes:

1. Concrete to be 3000 psi (normal WT) except slab at el. 310'-0" to be 3000 psi light wt. conc.
2. See approved elevator shop drawings for location, shape, and size of inserts in walls.

6" walls between el. 288'-0" and el. 310'-0" are acting as hangers to support slab at el. 294'-0". Therefore all shorings under 6" walls shall not be removed until completion.

LICENSED PROFESSIONAL ENGINEER — LESLIE E. ROBERTSON — No. 34360 — UNIVERSITY OF THE STATE OF NEW YORK

DESIGNED

DRAWN: SC.

REVIEWED: E.L.

(dwg. 3C-11 & 3C-11)

8-JK7-10.1