
SKILLING - HELLE - CHRISTIANSEN - ROBERTSON Structural & Civil Engineers

PROJECT THE WORLD TRADE CENTER | TITLE TYP. DET. OF STEEL BEAM OVER C.I.P. PERIMETER WALL | DATE 5-1-68

REVISIONS
7-9-68
1-24-69
3-25-69

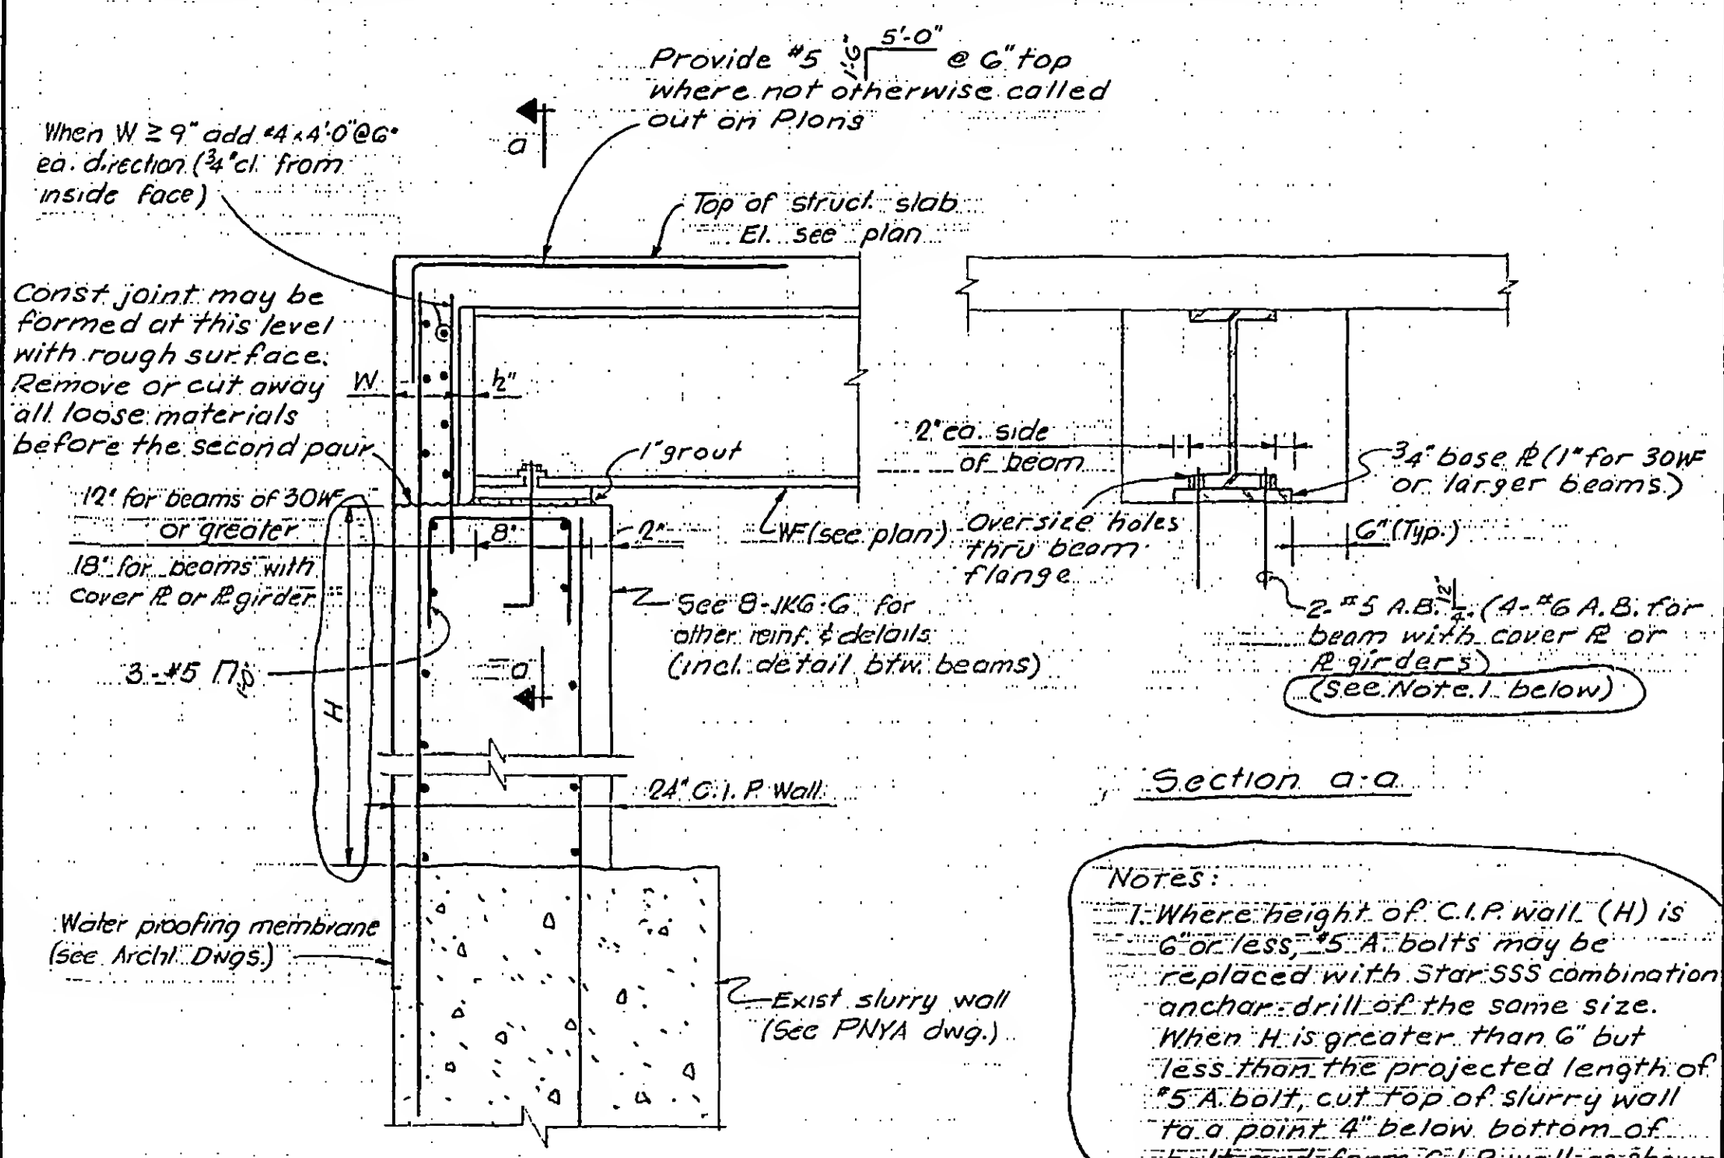

Section a-a

Notes:
1. Where height of C.I.P. wall (H) is 6" or less, #5 A. bolts may be replaced with Star SSS combination anchor drill of the same size. When H is greater than 6" but less than the projected length of #5 A. bolt, cut top of slurry wall to a point 4" below bottom of bolt and form C.I.P. wall as shown.

LICENSED PROFESSIONAL ENGINEER — LESLIE E. ROBERTSON — No. 34360 — UNIVERSITY OF THE STATE OF NEW YORK

DRAWN S.C.
REVIEWED E.L.

8-JKG-7