
SKILLING, HELLE, CHRISTIANSEN, ROBERTSON — Structural & Civil Engineers

PROJECT: THE WORLD TRADE CENTER | TITLE: TYPICAL DETAIL OF SLAB AT SLURRY WALL | DATE: 5-1-68

REVISIONS
2-6-69
4-2-69
4-9-69

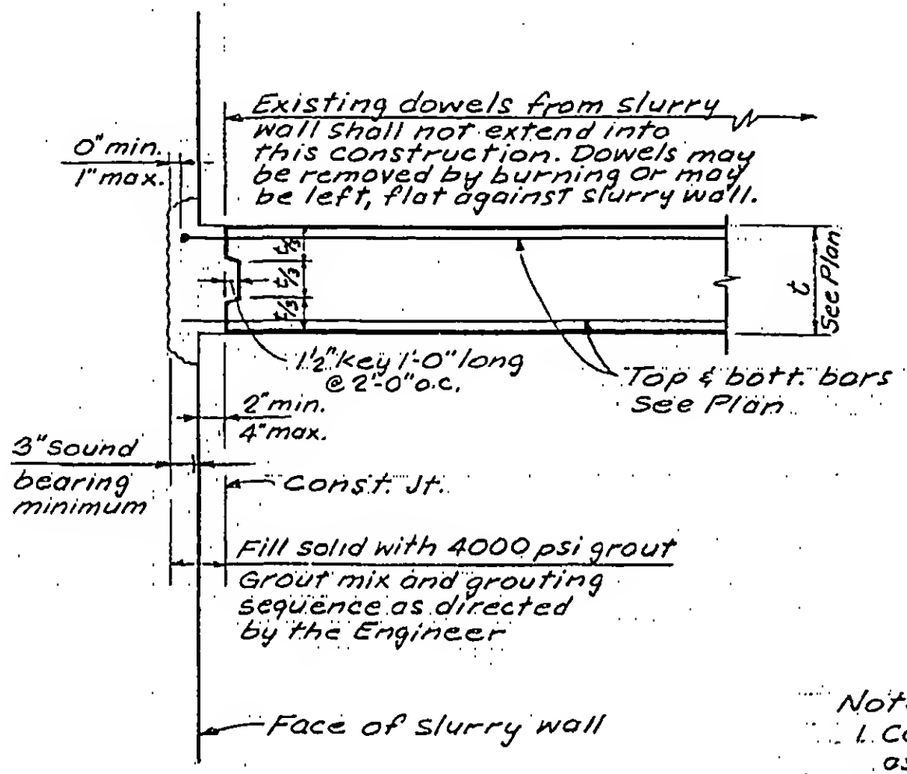

Notes:
1. Contractor shall deepen existing keys as required to obtain full bearing to the depth indicated in the drawings.
2. If required to obtain indicated bearing, keys shall be extended behind existing reinforcing steel within the slurry wall.
3. Contractor shall clean all loose or fractured material from within the key to expose sound concrete.
4. For slab at El. 253', see detail on 8-JK5-2.1

LICENSED PROFESSIONAL ENGINEER — LESLIE E. ROBERTSON — No. 34360 — UNIVERSITY OF THE STATE OF NEW YORK

DESIGNED
DRAWN S.C.
REVIEWED E.L. & L.E.R.

8-JK5-2