
SKILLING, HELLE, CHRISTIANSEN, ROBERTSON — Structural & Civil Engineers

PROJECT THE WORLD TRADE CENTER | TITLE SECTION AT SLOPE SLAB | DATE 7-1-69

REVISIONS

7-18-69

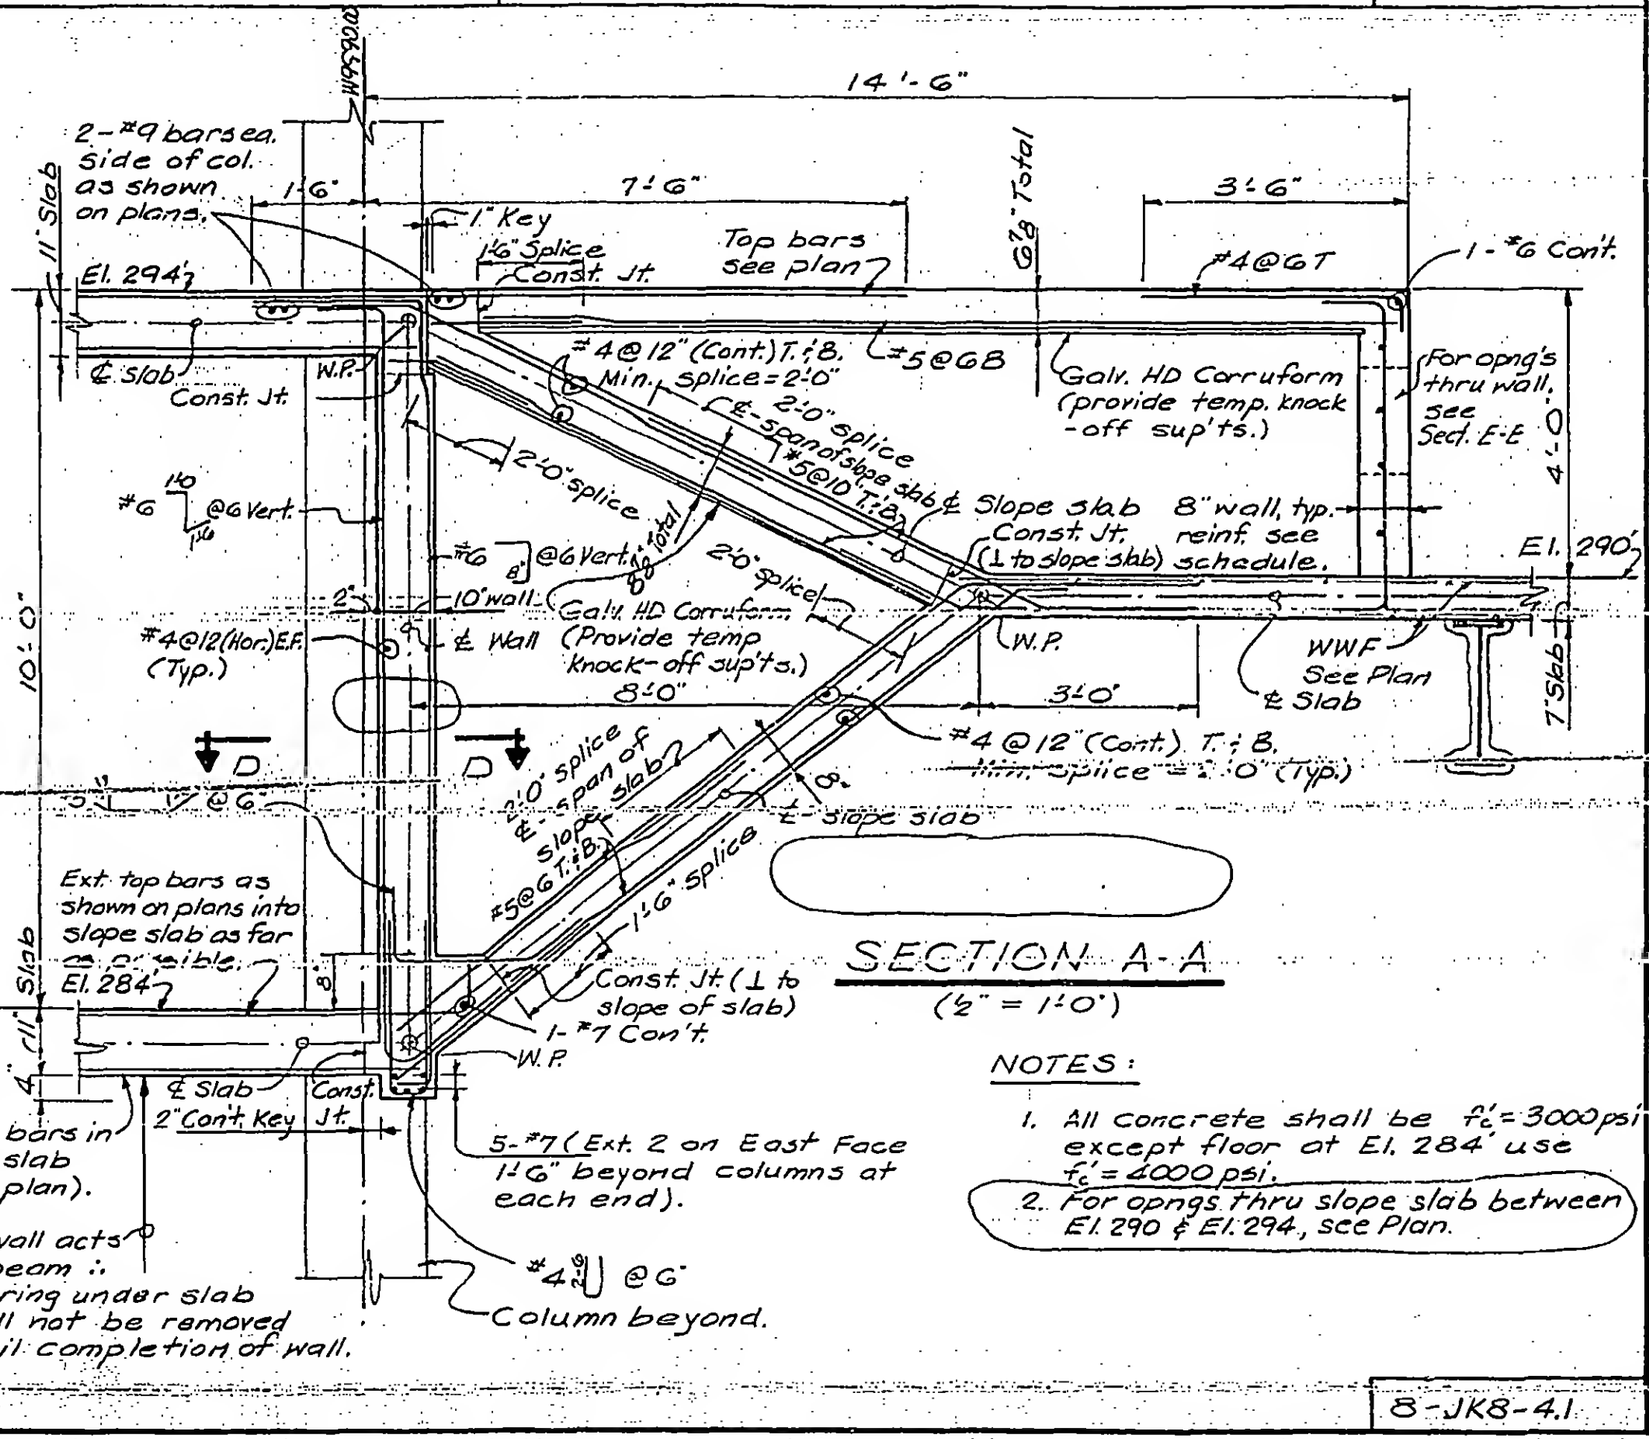

SECTION A-A

(½" = 1'-0")

NOTES:

1. All concrete shall be f'_c = 3000 psi except floor at El. 284' use f'_c = 4000 psi.
2. For opngs thru slope slab between El. 290 & El. 294, see Plan.

LICENSED PROFESSIONAL ENGINEER — LESLIE E. ROBERTSON — No. 34360 — UNIVERSITY OF THE STATE OF NEW YORK

DESIGNED

DRAWN G.S.

E.L.

8-JK8-4.1